

User guide

• **Kamstrup OMNIA® e-meter
- direct meters**



Disclaimer

All information provided in this document is copyright of Kamstrup. Licence is granted to the user to freely use and distribute the information in complete and unaltered form, provided that the purpose is to use or evaluate Kamstrup products. Distribution rights do not include public posting or mirroring on Internet websites. Only a link to the Kamstrup website can be provided on such public websites.

Kamstrup shall in no event be liable to any party for direct, indirect, special, general, incidental, or consequential damages arising from the use of this information or any derivative works thereof. The information is provided on an as-is basis, and thus comes with absolutely no warranty, either express or implied. No right or licence is granted under any intellectual property right, hereunder copyright, patent or trademark, of Kamstrup to any other party. This disclaimer includes, but is not limited to, implied warranties of merchantability, fitness for any particular purpose, and non-infringement.

Information in this document is subject to change without notice and should not be construed as a commitment by Kamstrup. While the information contained herein is believed to be accurate, Kamstrup assumes no responsibility for any errors and/or omissions that may appear in this document.

Copyright Information

Copyright © Kamstrup A/S
Industrivej 28
Stilling
DK-8660 Skanderborg, Denmark

All Rights Reserved

The graphics and content in this document are the copyrighted work of Kamstrup and contain proprietary trademarks and trade names of Kamstrup.

Third Parties

This document may contain links to other parties. Kamstrup makes no warranty or representation regarding any linked information appearing therein. Such links do not constitute an endorsement by Kamstrup of any such information and are provided only as a convenience. Kamstrup is not responsible for the content or links displayed by third parties.

Contents

1	Revision history	7
2	Introduction	8
2.1	Related documentation.....	8
3	Human interface	9
3.1	Meter buttons and interfaces.....	9
3.2	Meter display.....	10
3.3	Start-up sequence.....	12
4	Time management	14
4.1	Time synchronisation.....	14
4.2	Time keeping without supply voltage.....	14
4.3	Hour counters.....	14
4.4	Time zone.....	14
4.5	Daylight saving.....	14
4.6	Activity calendar and special days.....	14
5	Measuring engine	16
5.1	Instantaneous values.....	16
5.1.1	Aggregation across multiple phases.....	18
5.1.2	Power factor.....	19
5.1.3	Harmonic voltage and current distortion.....	20
5.2	Accumulated values.....	20
5.2.1	CT ratio.....	22
5.2.2	Secondary energy values.....	22
5.3	Mean values.....	23
5.4	Minimum and maximum values.....	24
5.4.1	Accumulated maximum power values.....	27
5.4.2	Values coinciding with min. and max. supply voltage.....	27
5.5	Tariff/TOU registers.....	29
6	Interval loggers	30
6.1	Load profile 1 (1.1.99.1.0.255).....	30
6.2	Load profile 2 (1.1.99.2.0.255).....	31

6.3	Debiting 1 logger (1.1.98.1.0.255)	31
6.4	Debiting 2 logger (1.1.98.2.0.255)	32
6.5	Analysis logger (1.1.99.1.1.255)	33
6.6	Occurrence counter logger (1.1.99.98.17.255)	33
6.7	GSM diagnostics logger (0.0.99.98.18.255)	35
6.8	Data quality attribute	36
7	Power quality	38
7.1	Power frequency	38
7.2	Overvoltage and undervoltage	38
7.3	Supply voltage interruption	39
7.3.1	Acting on a subset of connected phases	39
7.3.2	Acting on all connected phases	40
7.4	Rapid voltage change	40
7.5	Supply voltage unbalance	41
7.6	Total harmonic distortion	41
7.7	Supply voltage sags and swells	42
8	Grid events	45
8.1	Neutral fault	45
8.2	Phase asymmetry	45
9	Event loggers	46
9.1	Standard event logger (0.0.99.98.0.255)	46
9.2	Fraud detection event logger (0.0.99.98.1.255)	48
9.3	Disconnect control event logger (0.0.99.98.2.255)	48
9.4	Power quality event logger (0.0.99.98.4.255)	49
9.5	Communication event logger (0.0.99.98.5.255)	50
9.6	Access event logger (0.0.99.98.128.255)	51
9.7	CT ratio change event logger (1.1.99.98.9.255)	52
9.8	Load profile change event logger (1.1.99.98.10.255)	52
9.9	Calculation method change event logger (0.0.99.98.131.255)	53
10	Alarms	55
10.1	Alarm filter 1 (0.0.97.98.10.255)	55
10.2	Alarm filter 2 (0.0.97.98.11.255)	55

10.3	Alarm filter 3 (0.0.97.98.12.255).....	55
10.4	Alarm filter 4 (0.0.97.98.13.255).....	56
10.5	Alarm filter 5 (0.0.97.98.14.255).....	57
10.6	Alarm filter 6 (0.0.97.98.15.255).....	57
11	Last gasp	59
12	Grid snapshot (0.0.99.98.130.255).....	60
13	Communication with head-end system.....	62
13.1	Push setups.....	62
13.2	On-demand requests.....	63
13.3	Selection of access technology.....	64
14	Firmware upgrade.....	65
14.1	Audit loggers.....	65
14.1.1	Audit logger success (1.1.99.98.13.255).....	66
14.1.2	Audit logger fail (1.1.99.98.14.255).....	66
14.1.3	Audit logger non-legal (1.1.99.98.18.255).....	66
15	Data security.....	67
15.1	Digital signature of supply control switch commands.....	67
16	Communication interfaces.....	68
16.1	Cellular interface.....	68
16.2	Optical interface.....	68
16.3	Home area network (HAN).....	68
16.3.1	Physical interface (HAN).....	68
16.3.2	"Data" line specification.....	69
16.3.3	"Data Request" line specification.....	69
16.3.4	Protocol description (HAN).....	69
16.3.5	Data telegram (HAN).....	69
16.4	Hot swap extension interface.....	70
16.4.1	Compatible modules.....	70
17	Auxiliary power supply (APS) input.....	71
18	Supply control switch.....	72

18.1	Remote on-demand disconnect.....	72
18.2	Manual disconnect.....	72
18.3	Overvoltage disconnect.....	72
19	Load control switch.....	74
19.1	On-demand mode.....	74
19.2	Activity calendar mode.....	74
19.3	Active tariff mode.....	74
20	Unconnected phase detection.....	75
21	Temperature supervision.....	76
22	Demand supervision.....	77
22.1	Current supervision.....	77
22.2	Power supervision.....	77
22.3	Power factor supervision.....	78
23	Disposal of worn out meters.....	79

1 Revision history

Rev	Date	Description	Meter software revision
A1	2020-06-30	First release of this user guide.	50981625 feature pack 2.1
B1	2020-10-09	Added new features and changes to some interval logger defaults.	50981625 rev. D2
C1	2021-04-13	<ul style="list-style-type: none"> Added new features and sections. The sections about Communication with head-end system^[62] and Communication interfaces^[68] has been rearranged. The section about power quality has been split into Power quality^[38] and Grid events^[45]. 	50981625 rev. F7
D1	2021-10-05	<ul style="list-style-type: none"> Added new features and sections. The section about Supply voltage interruption^[39] has been moved to the Power quality^[38] section. 	50981625 rev. H5
E1	2022-03-14	<p>Added the following sections:</p> <ul style="list-style-type: none"> CT ratio^[22] Secondary energy values^[22] CT ratio change event logger^[52] Calculation method change event logger^[53] Data quality attribute^[36]. Added Min. and Max. THD values^[24] Accumulated max. power values^[27]. Selection of access technologies^[64]. Temperature supervision^[76]. Demand supervision^[77]. <p>Updated the following sections:</p> <ul style="list-style-type: none"> Grid Snapshot^[60] and HAN interface^[68] (both are now configurable). 	50981625 rev. J5 and 50981687 rev. B5

2 Introduction

This user guide describes the features and functionality of Kamstrup OMNIA® e-meter.

Kamstrup OMNIA® e-meter is a family of smart electricity meters. The meter is the engine behind an intelligent grid. The Energy Processing Unit (EPU) architecture of the meter makes it capable of processing and analysing energy measurements at a great time resolution. This is the key to absolute voltage quality reporting and the foundation for future analytics applications.

Kamstrup OMNIA® e-meter is available with a variety of communication and functional interfaces. It supports integrated IoT solutions, load control or a specific interface for smart home equipment. The integrated flexibility of the meter enables a fast and easy adaptation to customer and market demands.

Target group

This user guide is intended for technical users who wish to familiarise themselves with the features of Kamstrup OMNIA® e-meter for the purpose of setting up advanced operations, doing integrations with the meter, evaluating the meter for procurements or similar.

Knowledge of DLMS/COSEM and the DLMS UA "Coloured Books" is recommended, but not required, to read and understand this user guide.

2.1 Related documentation

In the following guides you will find additional documentation about Kamstrup OMNIA® e-meter and the DLMS interface:

- Installation guide "Installing Kamstrup OMNIA® e-meter" (doc. 5512-2370).
- Data sheet "Kamstrup OMNIA® e-meter single and three-phase" (doc. 5811-6542).
- Data sheet "Kamstrup OMNIA® e-meter CT" (doc. 5811-6726).
- Technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).
- Technical guide "Kamstrup OMNIA® e-meter single- and three-phase – object list" (doc. 5512-2683).
- "How to verify meter connectivity - a visual guide" (doc. 5512-2694).

3 Human interface

The following sections provide an overview of the display, buttons and interfaces of Kamstrup OMNIA® e-meter.

3.1 Meter buttons and interfaces

Below you see an overview and descriptions of the meter buttons and interfaces.

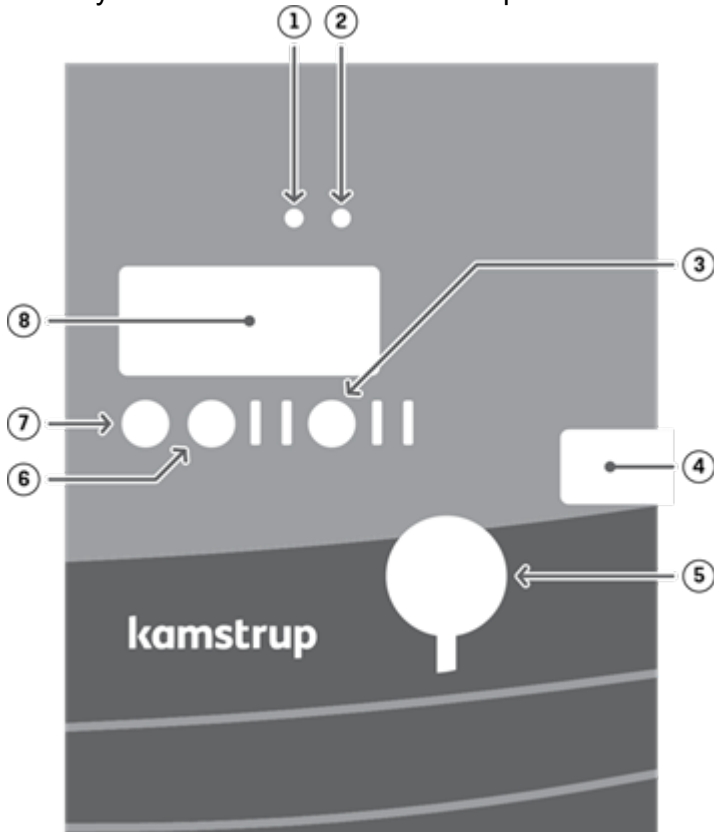


Figure 1: The buttons and interfaces of Kamstrup OMNIA® e-meter

Meter buttons and interfaces		
No.	Name	Description
1	Meter constant LED	The Meter constant LED blinks (yellow) at a rate reflecting the consumption of active energy.
2	Supply switch LED	The Supply switch LED is lit (red) when the internal supply switch is disconnected. If the LED blinks, the supply switch is released for reconnection.
3	Infra-red interface	The Infra-red interface is used to connect an infra-red optical head in order to display and change configuration parameters in the meter.
4	HAN interface	The home area network (HAN) interface is used to connect compatible smart home equipment. Note Not all meters have this interface.
5	Sealing wheel	The Sealing wheel is used to lock and unlock the terminal cover, secure that the cover is in place and seal the meter.
6	Control push button	The functionality of the Control push button depends on the meter configuration. On some meters, you can control the internal supply switch by pressing and holding this push button.
7	Menu push button	The Menu push button is used to cycle the information shown in the meter display, i.e. 8a-8n in the figure below. For descriptions of the meter display, see the table ¹¹ below.
8	Meter display	For descriptions of the meter display, see the table ¹¹ below.

3.2 Meter display

Below you see an overview and descriptions of the meter display.

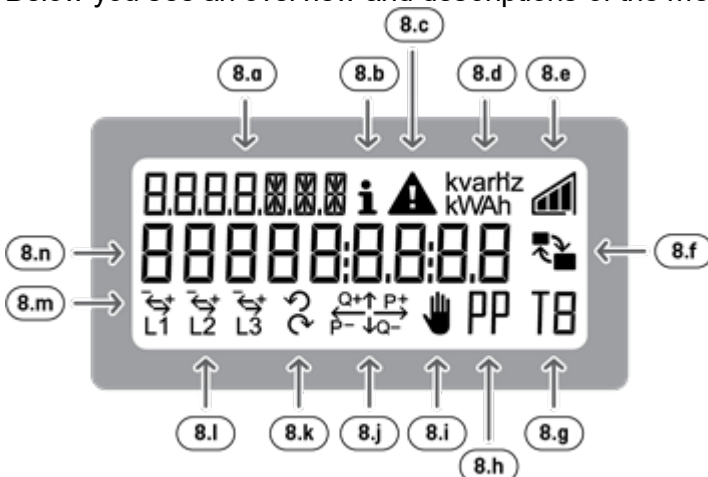



Figure 2: The display of Kamstrup OMNIA® e-meter

Meter display			
No.	Symbol	Name	Description
8a		Object identification field	The Object identification field uniquely identifies the measurand shown in the Value field, e.g. imported or exported energy, active or reactive energy, etc.
8b		Info	The Info symbol indicates that the Value field shows data of an informative nature, i.e. not legally relevant data.
8c		Error	The Error symbol indicates that an internal error has occurred in the meter. Can be triggered by: <ul style="list-style-type: none"> • Error accessing non-volatile data memory, i.e. during data backup or restore. • RAM test failure. • Error in program memory checksum. • Meter is operating in APS mode ⁷¹.
8d		Unit	The Unit field shows the unit of the measurand shown in the Value field.
8e		Network	The Network symbol shows the connection quality to the communication network.
8f		System	The System symbol indicates that there is a verified data connection to the head-end system.
8g		Tariff	The Tariff symbol indicates the tariff that is currently active.
8h		Prepayment	The Prepayment symbol indicates that the meter is in prepayment mode.
8i		Tamper	The Tamper symbol indicates if the meter has been exposed to attempts of physical or magnetic tampering. Can be triggered by: <ul style="list-style-type: none"> • Terminal cover is removed. • Magnetic field is detected.
8j		Quadrant	The Quadrant symbol indicates the current net load type.
8k		Phase sequence	The Phase sequence symbols indicate the sequence of the connected phases. <ul style="list-style-type: none"> • phase sequence is regular, e.g. L1-L2-L3. • phase sequence is irregular, e.g. L1-L3-L2.

Meter display			
8l	L1 L2 L3	Supply voltage	The Supply voltage symbols are lit when the associated phase input is connected, and the phase voltage is within the nominal voltage range.
8m		Phase current	<p>The Phase current symbols indicate the direction of the current for each phase.</p> <ul style="list-style-type: none"> • + energy is imported on the corresponding phase. • - energy is exported on the corresponding phase. <p>Use this to verify the correct sequence of input and output cables.</p>
8n	88888:88:88	Value	The Value field shows the consumption data value of the measurand.

3.3 Start-up sequence

Energizing the Kamstrup OMNIA® e-meter initiates the start-up sequence. The diagram below visualizes the states of the meter display during the start-up sequence.

The meter begins to record energy within 5 seconds from being energized.

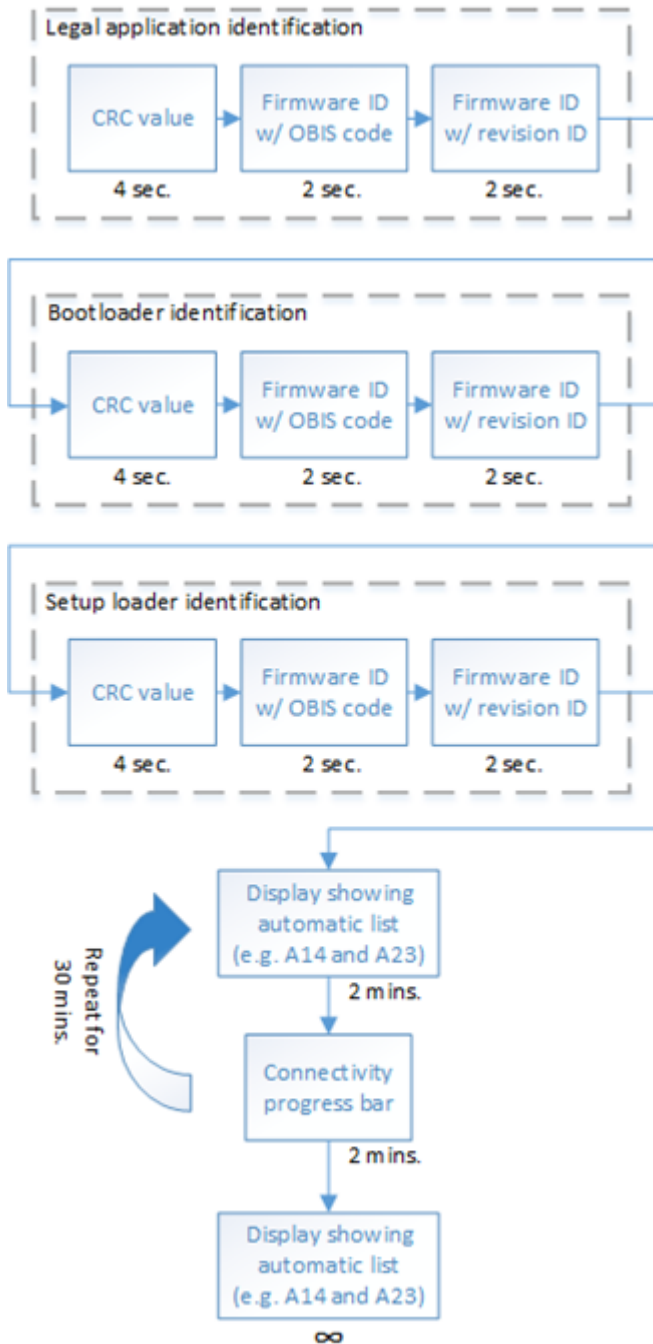


Figure 3: Meter display states during the start-up sequence

The meter initiates registration on the cellular network shortly after being energized. Several steps in the connectivity progress bar are often completed when it is shown for the first time.

Hint For a visual guide through the start-up sequence, see "How to verify meter connectivity - a visual guide" (doc. 5512-2694).

For details about the connectivity progress bar, see the installation guide "Installing Kamstrup OMNIA® e-meter" (doc. 5512-2370).

4 Time management

Time management in Kamstrup OMNIA® e-meter is based on the integrated real-time clock (RTC) and the DLMS Clock class.

4.1 Time synchronisation

Network Time Protocol (NTP) is used to retrieve accurate time. Initial NTP synchronisation is executed upon successful meter installation.

The first synchronisation after initial NTP synchronisation will happen at a random time between 0-24 hours. After that, NTP synchronisations will happen every 24 hours.

Any changes to meter time larger than 7 seconds will mark affected interval logger entries using the [Data quality attribute](#) [36].

If the meter time is adjusted forward (i.e. to a later point in time), any missing logger entries are automatically generated with identical value as recommended in WELMEC guide 11.2. Any automatically generated entries are marked using the Data quality attribute.

4.2 Time keeping without supply voltage

The time continues to be maintained during a supply voltage interruption due to the integrated backup energy storage (either a battery or a rechargeable energy storage unit (supercap)).

4.3 Hour counters

An hour counter register keeps track of the number of meter operating hours. As a supplement to the total hour counter, the meter maintains separate counters for all tariffs.

4.4 Time zone

The time zone of the meter is selected at order time and the meter display, time stamps, interval loggers, push setups and activity calendars operate in local time.

4.5 Daylight saving

Kamstrup OMNIA® e-meter handles daylight saving time. The daylight saving schedule can be programmed in the meter using wildcards through the DLMS Clock class.

Daylight saving can be disabled.

4.6 Activity calendar and special days

Kamstrup OMNIA® e-meter uses separate activity calendars for tariffs and load control. An activity calendar can contain up to four different seasons. Each season consists of a week profile built from three day profiles: working days, non-working days and holidays.

A day profile schedules up to 10 actions with a time resolution of 1 minute.

The activity calendar can handle up to four seasons in a year.

The activity calendar can handle a list of 65 user-defined special days (exact days, not wildcards). Special days have the same activity schedule as holidays. The special days table is a shared component for all activity calendars.

5 Measuring engine

Kamstrup OMNIA® e-meter measures and calculates a range of electric parameters based on different time intervals.

5.1 Instantaneous values

Single-cycle measurements are aggregated into intervals of 1 second duration (instantaneous values). Some instantaneous values, e.g. power values, are calculated and have a refresh rate of 1Hz.

Instantaneous values can be collected remotely by means of on-demand readings.

Kamstrup OMNIA® e-meter can be configured to push a snapshot of instantaneous values to the head-end system when selectable triggers are activated. For a detailed description, see [Grid Snapshot](#)^[60].

Note Objects representing RMS currents are unsigned, i.e. they hold absolute values with no indication of current flow direction.

OBIS code	Description
1.1.1.7.0.255	Active power P14
1.1.2.7.0.255	Active power P23
1.1.3.7.0.255	Reactive power Q12
1.1.4.7.0.255	Reactive power Q34
1.1.9.7.0.255	Apparent power S14
1.1.10.7.0.255	Apparent power S23
1.1.13.7.0.255	Power factor total
1.1.14.7.0.255	Frequency
1.1.21.7.0.255	Active power P14 of phase 1
1.1.41.7.0.255	--- of phase 2
1.1.61.7.0.255	--- of phase 3
1.1.22.7.0.255	Active power P23 of phase 1
1.1.42.7.0.255	--- of phase 2
1.1.62.7.0.255	--- of phase 3
1.1.23.7.0.255	Reactive power Q12 of phase 1
1.1.43.7.0.255	--- of phase 2
1.1.63.7.0.255	--- of phase 3
1.1.24.7.0.255	Reactive power Q34 of phase 1
1.1.44.7.0.255	--- of phase 2
1.1.64.7.0.255	--- of phase 3
1.1.29.7.0.255	Apparent power S14 of phase 1
1.1.49.7.0.255	--- of phase 2
1.1.69.7.0.255	--- of phase 3
1.1.30.7.0.255	Apparent power S23 of phase 1

OBIS code	Description
1.1.50.7.0.2551	--- of phase 2
1.1.70.7.0.255	--- of phase 3
1.1.31.7.0.255	RMS current of phase 1
1.1.51.7.0.255	--- of phase 2
1.1.71.7.0.255	--- of phase 3
1.1.31.7.3.255	3rd harmonic RMS current of phase 1
1.1.51.7.3.255	--- of phase 2
1.1.71.7.3.255	--- of phase 3
1.1.31.7.5.255	5th harmonic RMS current of phase 1
1.1.51.7.5.255	--- of phase 2
1.1.71.7.5.255	--- of phase 3
1.1.31.7.7.255	7th harmonic RMS current of phase 1
1.1.51.7.7.255	--- of phase 2
1.1.71.7.7.255	--- of phase 3
1.1.31.7.11.255	11th harmonic RMS current of phase 1
1.1.51.7.11.255	--- of phase 2
1.1.71.7.11.255	--- of phase 3
1.1.31.7.124.255	THD current of phase 1
1.1.51.7.124.255	--- of phase 2
1.1.71.7.124.255	--- of phase 3
1.1.32.7.0.255	RMS voltage of phase 1
1.1.52.7.0.255	--- of phase 2
1.1.72.7.0.255	--- of phase 3
1.1.32.7.3.255	3rd harmonic RMS voltage of phase 1
1.1.52.7.3.255	--- of phase 2
1.1.72.7.3.255	--- of phase 3
1.1.32.7.5.255	5th harmonic RMS voltage of phase 1
1.1.52.7.5.255	--- of phase 2
1.1.72.7.5.255	--- of phase 3
1.1.32.7.7.255	7th harmonic RMS voltage of phase 1
1.1.52.7.7.255	--- of phase 2
1.1.72.7.7.255	--- of phase 3
1.1.32.7.11.255	11th harmonic RMS voltage of phase 1
1.1.52.7.11.255	--- of phase 2
1.1.72.7.11.255	--- of phase 3
1.1.32.7.124.255	THD voltage of phase 1
1.1.52.7.124.255	--- of phase 2
1.1.72.7.124.255	--- of phase 3
1.1.33.7.0.255	Power factor of phase 1
1.1.53.7.0.255	--- of phase 2

OBIS code	Description
1.1.73.7.0.255	--- of phase 3

5.1.1 Aggregation across multiple phases

In a multi-phase meter, the instantaneous power values per phase can be aggregated into instantaneous power totals. The aggregation is based on one of the calculation methods below and is selectable at ordering.

Calculation method	Active energy examples		Description
	Per phase contribution	Aggregated total	
Individual import/export			The individual import/export calculation method has one register for the positive contributions and one for the negative contributions.
Vector summation			When using the vector summation calculation, the positive contributions are added and the negative contributions are subtracted in the same way as by electromechanical meters. Contributions from e.g. solar energy installations will be set off in the total energy calculation.
Total summation			The total summation calculation adds all contributions to the positive register whether one or more phases contribute with negative energy.

Figure 4: Simple view of aggregation of power across multiple phases, taking only active energy into consideration

A detailed view on multi-phase aggregation showing the effect on reactive power is shown below using the diagrammed example of complex powers S'_{L1} , S'_{L2} and S'_{L3}

Note The complex powers should not be confused with the apparent powers S_{L1} , S_{L2} and S_{L3} given by the relation $S_{Ln} = |S'_{Ln}|$.

In *total summation*, any complex power in the negative active power regime (S'_{L3} in the example), is translated to the positive active power regime as the first step of the aggregation.

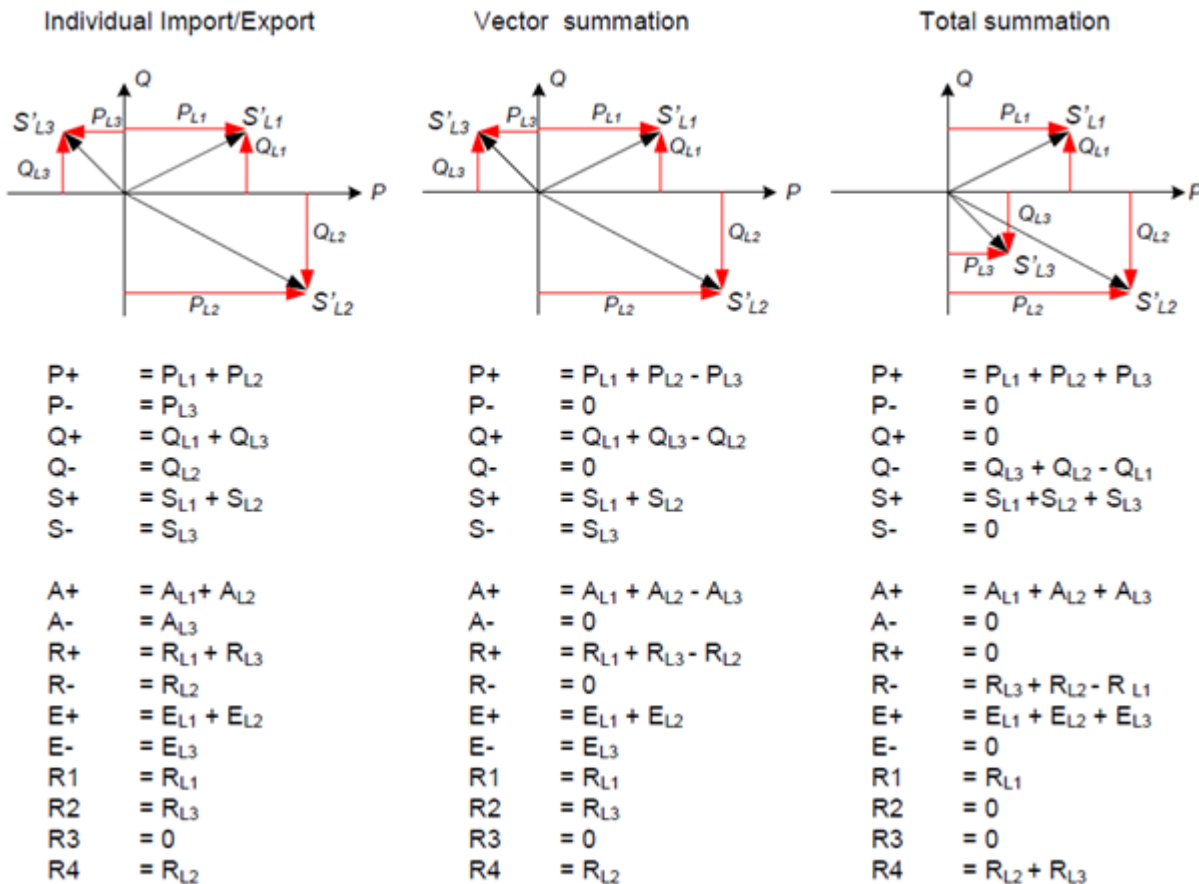


Figure 5: Detailed view of aggregation of power across multiple phases, covering both active, reactive and apparent power

5.1.2 Power factor

Kamstrup OMNIA® e-meter calculates the true power factor (TPF) from the ratio between active power and apparent power. The instantaneous values of power factor per phase are calculated from the active and apparent power per phase:

Power factor of phase n = active power of phase n / apparent power of phase n

where active and apparent power can be any combination of import (P14, S14) or export (P23, S23) depending on the electrical load.

In a multi-phase meter, the instantaneous power factors per phase are aggregated into an instantaneous power factor total:

Power factor total = active power total / apparent power total

where active and apparent power totals are aggregated across phases based on the vector sum calculation method. This aggregation method is independent of the global power aggregation method selected for the meter.

Note Objects representing power factor are unsigned, i.e. they hold absolute values with no indication of power flow direction.

5.1.3 Harmonic voltage and current distortion

Kamstrup OMNIA® e-meter measures harmonic content of voltage and current at individual harmonic frequencies. This feature complements the total harmonic distortion (THD) by providing additional details of which harmonic frequencies are dominating and their levels.

The meter records individual harmonic content of both voltage and current. A selected set is presented in individual harmonic content objects. All individual harmonic content objects operate per phase and are available as instantaneous values and as mean values.

Additionally, the meter calculates the total harmonic distortion of both voltage (THDU) and current (THDI). The calculations of THDU and THDI include each harmonic frequency up to the 50th harmonic.

The definition of THDU is given below as a function of the relative amplitudes (u_h) which is the harmonic voltage related to the fundamental voltage, where h is the order of the harmonic.

$$THDU = \sqrt{\sum_{h=2}^{50} (u_h)^2}$$

Figure 6: THDU definition

5.2 Accumulated values

Accumulated values are incremented each time the corresponding instantaneous value is refreshed.

Example:

Each time P14 is refreshed, the active energy A14 is incremented by $P14 \times \Delta t$.

OBIS code	Description
0.1.96.8.0.255	Hour counter
1.1.0.1.0.255	Billing period counter
1.1.1.8.0.128	Active energy A14 (high resolution for verification purposes only)
1.1.1.8.0.255	Active energy A14
1.1.1.8.x.255	Active energy A14 for tariff x (1≤x≤8)
1.1.2.8.0.128	Active energy A23 (high resolution for verification purposes only)
1.1.2.8.0.255	Active energy A23
1.1.2.8.x.255	Active energy A23 for tariff x (1≤x≤8)
1.1.3.8.0.128	Reactive energy R12 (high resolution for verification purposes only)

OBIS code	Description
1.1.3.8.0.255	Reactive energy R12
1.1.3.8.x.255	Reactive energy R12 for tariff x ($1 \leq x \leq 8$)
1.1.4.8.0.128	Reactive energy R34 (high resolution for verification purposes only)
1.1.4.8.0.255	Reactive energy R34
1.1.4.8.x.255	Reactive energy R34 for tariff x ($1 \leq x \leq 8$)
1.1.5.8.0.128	Reactive energy R1 (high resolution for verification purposes only)
1.1.5.8.0.255	Reactive energy R1
1.1.5.8.x.255	Reactive energy R1 for tariff x ($1 \leq x \leq 8$)
1.1.6.8.0.128	Reactive energy R2 (high resolution for verification purposes only)
1.1.6.8.0.255	Reactive energy R2
1.1.6.8.x.255	Reactive energy R2 for tariff x ($1 \leq x \leq 8$)
1.1.7.8.0.128	Reactive energy R3 (high resolution for verification purposes only)
1.1.7.8.0.255	Reactive energy R3
1.1.7.8.x.255	Reactive energy R3 for tariff x ($1 \leq x \leq 8$)
1.1.8.8.0.128	Reactive energy R4 (high resolution for verification purposes only)
1.1.8.8.0.255	Reactive energy R4
1.1.8.8.x.255	Reactive energy R4 for tariff x ($1 \leq x \leq 8$)
1.1.9.8.0.255	Apparent energy E14
1.1.9.8.x.255	Apparent energy E14 for tariff x ($1 \leq x \leq 8$)
1.1.10.8.0.255	Apparent energy E23
1.1.10.8.x.255	Apparent energy E23 for tariff x ($1 \leq x \leq 8$)
1.1.15.8.0.255	Active energy A1234
1.1.16.8.0.255	Active energy net ($ A14 - A23 $)
1.1.21.8.0.255	Active energy A14 of phase 1
1.1.41.8.0.255	--- of phase 2
1.1.61.8.0.255	--- of phase 3
1.1.22.8.0.255	Active energy A23 of phase 1
1.1.42.8.0.255	--- of phase 2
1.1.62.8.0.255	--- of phase 3
1.1.23.8.0.255	Reactive energy R12 of phase 1
1.1.43.8.0.255	--- of phase 2
1.1.63.8.0.255	--- of phase 3
1.1.24.8.0.255	Reactive energy R34 of phase 1
1.1.44.8.0.255	--- of phase 2
1.1.64.8.0.255	--- of phase 3
1.1.29.8.0.255	Apparent energy E14 of phase 1
1.1.49.8.0.255	--- of phase 2
1.1.69.8.0.255	--- of phase 3
1.1.30.8.0.255	Apparent energy E23 of phase 1
1.1.50.8.0.255	--- of phase 2

OBIS code	Description
1.1.70.8.0.255	--- of phase 3

5.2.1 CT ratio

A CT meter is connected to the electrical grid through current transformers. The CT ratio is what relates the energy measured by the meter to the energy at the primary side of the current transformer (i.e. the energy actually imported or exported). It must be selected to match the current transformers used in the installation.

The CT ratio is selected at order time and can be changed subsequently if the current transformers in the installation should be exchanged. Any changes to the CT ratio trigger an entry in the [CT ratio change event logger](#)⁵².

The CT ratio is expressed as a ratio (e.g. 5:1 or 120:1) and can take values from 1:1 to 600:1 (in steps of 1).

5.2.2 Secondary energy values

Special to Kamstrup OMNIA® e-meter CT is the energy values as measured on the secondary side of the current transformer. These are referred to as the secondary energy values.

Since a CT meter is, by definition, connected through current transformers, secondary energy values are what the meter really measures. Primary energy values are calculated from the secondary energy values multiplied by the [CT ratio](#)²².

OBIS code	Description
1.1.1.8.0.129	Active secondary energy A14
1.1.1.8.x.129	Active secondary energy A14 for tariff x (1≤x≤8)
1.1.2.8.0.129	Active secondary energy A23
1.1.2.8.x.129	Active secondary energy A23 for tariff x (1≤x≤8)
1.1.3.8.0.129	Reactive secondary energy R12
1.1.3.8.x.129	Reactive secondary energy R12 for tariff x (1≤x≤8)
1.1.4.8.0.129	Reactive secondary energy R34
1.1.4.8.x.129	Reactive secondary energy R34 for tariff x (1≤x≤8)
1.1.5.8.0.129	Reactive secondary energy R1
1.1.5.8.x.129	Reactive secondary energy R1 for tariff x (1≤x≤8)
1.1.6.8.0.129	Reactive secondary energy R2
1.1.6.8.x.129	Reactive secondary energy R2 for tariff x (1≤x≤8)
1.1.7.8.0.129	Reactive secondary energy R3
1.1.7.8.x.129	Reactive secondary energy R3 for tariff x (1≤x≤8)
1.1.8.8.0.129	Reactive secondary energy R4
1.1.8.8.x.129	Reactive secondary energy R4 for tariff x (1≤x≤8)
1.1.9.8.0.129	Apparent secondary energy E14
1.1.9.8.x.129	Apparent secondary energy E14 for tariff x (1≤x≤8)
1.1.10.8.0.129	Apparent secondary energy E23
1.1.10.8.x.129	Apparent secondary energy E23 for tariff x (1≤x≤8)

5.3 Mean values

Kamstrup OMNIA® e-meter calculates the mean value of several measurands. For each time frame, the mean value is calculated and the mean value register is refreshed.

Note Objects representing RMS currents are unsigned, i.e. they hold absolute values with no indication of current flow direction.

OBIS code	Description	Time frame
1.1.1.25.0.255	Average active power P14	Load profile 1 capture period
1.1.2.25.0.255	Average active power P23	Load profile 1 capture period
1.1.3.25.0.255	Average reactive power Q12	Load profile 1 capture period
1.1.4.25.0.255	Average reactive power Q34	Load profile 1 capture period
1.1.9.25.0.255	Average apparent power S14	Load profile 1 capture period
1.1.10.25.0.255	Average apparent power S23	Load profile 1 capture period
1.1.13.25.0.255	Average power factor total	Analysis logger capture period
1.1.14.25.0.255	Average frequency	10 seconds
1.1.21.25.0.255	Average active power P14 of phase 1	Analysis logger capture period
1.1.41.25.0.255	--- of phase 2	Analysis logger capture period
1.1.61.25.0.255	--- of phase 3	Analysis logger capture period
1.1.22.25.0.255	Average active power P23 of phase 1	Analysis logger capture period
1.1.42.25.0.255	--- of phase 2	Analysis logger capture period
1.1.62.25.0.255	--- of phase 3	Analysis logger capture period
1.1.23.25.0.255	Average reactive power Q12 of phase 1	Analysis logger capture period
1.1.43.25.0.255	--- of phase 2	Analysis logger capture period
1.1.63.25.0.255	--- of phase 3	Analysis logger capture period
1.1.24.25.0.255	Average reactive power Q34 of phase 1	Analysis logger capture period
1.1.44.25.0.255	--- of phase 2	Analysis logger capture period
1.1.64.25.0.255	--- of phase 3	Analysis logger capture period
1.1.29.25.0.255	Average apparent power S14 of phase 1	Analysis logger capture period
1.1.49.25.0.255	--- of phase 2	Analysis logger capture period
1.1.69.25.0.255	--- of phase 3	Analysis logger capture period
1.1.30.25.0.255	Average apparent power S23 of phase 1	Analysis logger capture period
1.1.50.25.0.255	--- of phase 2	Analysis logger capture period
1.1.70.25.0.255	--- of phase 3	Analysis logger capture period
1.1.31.25.0.255	Average RMS current of phase 1	Analysis logger capture period
1.1.51.25.0.255	--- of phase 2	Analysis logger capture period
1.1.71.25.0.255	--- of phase 3	Analysis logger capture period
1.1.31.25.3.255	3rd harmonic average RMS current of phase 1	Analysis logger capture period
1.1.51.25.3.255	--- of phase 2	Analysis logger capture period
1.1.71.25.3.255	--- of phase 3	Analysis logger capture period
1.1.31.25.5.255	5th harmonic average RMS current of phase 1	Analysis logger capture period
1.1.51.25.5.255	--- of phase 2	Analysis logger capture period
1.1.71.25.5.255	--- of phase 3	Analysis logger capture period

OBIS code	Description	Time frame
1.1.31.25.7.255	7th harmonic average RMS current of phase 1	Analysis logger capture period
1.1.51.25.7.255	--- of phase 2	Analysis logger capture period
1.1.71.25.7.255	--- of phase 3	Analysis logger capture period
1.1.31.25.11.255	11th harmonic average RMS current of phase 1	Analysis logger capture period
1.1.51.25.11.255	--- of phase 2	Analysis logger capture period
1.1.71.25.11.255	--- of phase 3	Analysis logger capture period
1.1.31.24.124.255	Average THD current of phase 1	Analysis logger capture period
1.1.51.24.124.255	--- of phase 2	Analysis logger capture period
1.1.71.24.124.255	--- of phase 3	Analysis logger capture period
1.1.32.25.0.255	Average RMS voltage of phase 1	Analysis logger capture period
1.1.52.25.0.255	--- of phase 2	Analysis logger capture period
1.1.72.25.0.255	--- of phase 3	Analysis logger capture period
1.1.32.25.3.255	3rd harmonic average RMS voltage of phase 1	Analysis logger capture period
1.1.52.25.3.255	--- of phase 2	Analysis logger capture period
1.1.72.25.3.255	--- of phase 3	Analysis logger capture period
1.1.32.25.5.255	5th harmonic average RMS voltage of phase 1	Analysis logger capture period
1.1.52.25.5.255	--- of phase 2	Analysis logger capture period
1.1.72.25.5.255	--- of phase 3	Analysis logger capture period
1.1.32.25.7.255	7th harmonic average RMS voltage of phase 1	Analysis logger capture period
1.1.52.25.7.255	--- of phase 2	Analysis logger capture period
1.1.72.25.7.255	--- of phase 3	Analysis logger capture period
1.1.32.25.11.255	11th harmonic average RMS voltage of phase 1	Analysis logger capture period
1.1.52.25.11.255	--- of phase 2	Analysis logger capture period
1.1.72.25.11.255	--- of phase 3	Analysis logger capture period
1.1.32.24.124.255	Average THD voltage of phase 1	Analysis logger capture period
1.1.52.24.124.255	--- of phase 2	Analysis logger capture period
1.1.72.24.124.255	--- of phase 3	Analysis logger capture period
1.1.33.25.0.255	Average power factor of phase 1	Analysis logger capture period
1.1.53.25.0.255	--- of phase 2	Analysis logger capture period
1.1.73.25.0.255	--- of phase 3	Analysis logger capture period

5.4 Minimum and maximum values

Kamstrup OMNIA® e-meter registers the extremes (minimum and maximum values) of several measurands. During the extreme value time frame, the mean value is continuously compared to the latest extreme value. If the new value exceeds the latest extreme value, it replaces it. At the end of the extreme value time frame, the minimum and maximum value registers are reset.

Note Objects representing RMS currents are unsigned, i.e. they hold absolute values with no indication of current flow direction.

Objects holding minimum and maximum values include a time stamp of the time when that minimum or maximum was recorded. Adding both value and time stamp to an interval logger takes up two “slots”.

OBIS code	Description	Averaging time frame	Extreme value time frame
1.1.1.6.0.255	Max. active power P14	Load profile 1 capture period	Debiting 1 logger capture period
1.1.1.6.x.255	Max. active power P14 for tariff x ($1 \leq x \leq 8$)	Load profile 1 capture period	Debiting 1 logger capture period
1.1.2.6.0.255	Max. active power P23	Load profile 1 capture period	Debiting 1 logger capture period
1.1.2.6.x.255	Max. active power P23 for tariff x ($1 \leq x \leq 4$)	Load profile 1 capture period	Debiting 1 logger capture period
1.1.3.6.0.255	Max. reactive power Q12	Load profile 1 capture period	Debiting 1 logger capture period
1.1.3.6.x.255	Max. reactive power Q12 for tariff x ($1 \leq x \leq 4$)	Load profile 1 capture period	Debiting 1 logger capture period
1.1.4.6.0.255	Max. reactive power Q34	Load profile 1 capture period	Debiting 1 logger capture period
1.1.4.6.x.255	Max. reactive power Q34 for tariff x ($1 \leq x \leq 4$)	Load profile 1 capture period	Debiting 1 logger capture period
1.1.9.6.0.255	Max. apparent power S14	Load profile 1 capture period	Debiting 1 logger capture period
1.1.9.6.x.255	Max. apparent power S14 for tariff x ($1 \leq x \leq 8$)	Load profile 1 capture period	Debiting 1 logger capture period
1.1.10.6.0.255	Max. apparent power S23	Load profile 1 capture period	Debiting 1 logger capture period
1.1.21.3.128.255	Min. active power P14 of phase 1	Instantaneous value	Analysis logger capture period
1.1.41.3.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.61.3.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.21.6.128.255	Max. active power P14 of phase 1	Instantaneous value	Analysis logger capture period
1.1.41.6.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.61.6.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.29.3.128.255	Min. apparent power S14 of phase 1	Instantaneous value	Analysis logger capture period
1.1.49.3.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.69.3.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.29.6.128.255	Max. apparent power S14 of phase 1	Instantaneous value	Analysis logger capture period

OBIS code	Description	Averaging time frame	Extreme value time frame
1.1.49.6.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.69.6.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.31.3.128.255	Min. RMS current of phase 1	Instantaneous value	Analysis logger capture period
1.1.51.3.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.71.3.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.31.6.128.255	Max. RMS current of phase 1	Instantaneous value	Analysis logger capture period
1.1.51.6.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.71.6.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.31.3.132.255	Min. THD current of phase 1	Instantaneous value	Analysis logger capture period
1.1.51.3.132.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.71.3.132.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.31.6.132.255	Max. THD current of phase 1	Instantaneous value	Analysis logger capture period
1.1.51.6.132.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.71.6.132.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.32.3.128.255	Min. RMS voltage of phase 1	Instantaneous value	Analysis logger capture period
1.1.52.3.128.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.72.3.128.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.32.3.130.255	Min. daily RMS voltage of phase 1	Instantaneous value	Daily (at midnight local time)
1.1.52.3.130.255	--- of phase 2	Instantaneous value	Daily (at midnight local time)
1.1.72.3.130.255	--- of phase 3	Instantaneous value	Daily (at midnight local time)
1.1.32.6.129.255	Max. RMS voltage of phase 1	Instantaneous value	Analysis logger capture period
1.1.52.6.129.255	--- of phase 2	Instantaneous value	Analysis logger capture period

OBIS code	Description	Averaging time frame	Extreme value time frame
1.1.72.6.129.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.32.6.131.255	Max. daily RMS voltage of phase 1	Instantaneous value	Daily (at midnight local time)
1.1.52.6.131.255	--- of phase 2	Instantaneous value	Daily (at midnight local time)
1.1.72.6.131.255	--- of phase 3	Instantaneous value	Daily (at midnight local time)
1.1.32.3.133.255	Min. THD voltage of phase 1	Instantaneous value	Analysis logger capture period
1.1.52.3.133.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.72.3.133.255	--- of phase 3	Instantaneous value	Analysis logger capture period
1.1.32.6.133.255	Max. THD voltage of phase 1	Instantaneous value	Analysis logger capture period
1.1.52.6.133.255	--- of phase 2	Instantaneous value	Analysis logger capture period
1.1.72.6.133.255	--- of phase 3	Instantaneous value	Analysis logger capture period

5.4.1 Accumulated maximum power values

Each time a billing period is reset, either by user interaction or automatically at end of month, the maximum power values of the billing period that just ended are added to the accumulated maximum power values. These values can be used to track maximum power values in situations with several irregular billing period resets.

Hint Maximum power values are also known as maximum demand.

OBIS code	Description
1.1.1.2.0.255	Accumulated max. active power P14
1.1.1.2.x.255	Accumulated max. active power P14 for tariff x ($1 \leq x \leq 2$)
1.1.2.2.0.255	Accumulated max. active power P23
1.1.2.2.x.255	Accumulated max. active power P23 for tariff x ($1 \leq x \leq 2$)
1.1.3.2.0.255	Accumulated max. reactive power Q12
1.1.4.2.0.255	Accumulated max. reactive power Q34

5.4.2 Values coinciding with min. and max. supply voltage

The following instantaneous values are captured at the time of minimum and maximum RMS phase voltage resetting synchronously to the Analysis logger capture period.

Hint For details about the behavior and reset time of minimum and maximum values, see [Minimum and maximum values](#)^[24].

OBIS code	Description	Capture trigger
1.1.21.7.128.255	Active power P14 at the time of the min. RMS voltage of phase 1	1.1.32.3.128.255
1.1.41.7.128.255	--- of phase 2	1.1.52.3.128.255
1.1.61.7.128.255	--- of phase 3	1.1.72.3.128.255
1.1.21.7.129.255	Active power P14 at the time of the max. RMS voltage of phase 1	1.1.32.6.129.255
1.1.41.7.129.255	--- of phase 2	1.1.52.6.129.255
1.1.61.7.129.255	--- of phase 3	1.1.72.6.129.255
1.1.29.7.128.255	Apparent power S14 at the time of the min. RMS voltage of phase 1	1.1.32.3.128.255
1.1.49.7.128.255	--- of phase 2	1.1.52.3.128.255
1.1.69.7.128.255	--- of phase 3	1.1.72.3.128.255
1.1.29.7.129.255	Apparent power S14 at the time of the max. RMS voltage of phase 1	1.1.32.6.129.255
1.1.49.7.129.255	--- of phase 2	1.1.52.6.129.255
1.1.69.7.129.255	--- of phase 3	1.1.72.6.129.255
1.1.31.7.128.255	RMS current at the time of the min. RMS voltage of phase 1	1.1.32.3.128.255
1.1.51.7.128.255	--- of phase 2	1.1.52.3.128.255
1.1.71.7.128.255	--- of phase 3	1.1.72.3.128.255
1.1.31.7.129.255	RMS current at the time of the max. RMS voltage of phase 1	1.1.32.6.129.255
1.1.51.7.129.255	--- of phase 2	1.1.52.6.129.255
1.1.71.7.129.255	--- of phase 3	1.1.72.6.129.255

The following instantaneous values are captured at the time of minimum and maximum RMS phase voltage resetting daily at midnight local time.

Hint For details about the behavior and reset time of minimum and maximum values, see [Minimum and maximum values](#) ²⁴.

OBIS code	Description	Capture trigger
1.1.21.7.130.255	Active power P14 at the time of the min. daily RMS voltage of phase 1	1.1.32.3.130.255
1.1.41.7.130.255	--- of phase 2	1.1.52.3.130.255
1.1.61.7.130.255	--- of phase 3	1.1.72.3.130.255
1.1.21.7.131.255	Active power P14 at the time of the max. daily RMS voltage of phase 1	1.1.32.6.131.255
1.1.41.7.131.255	--- of phase 2	1.1.52.6.131.255
1.1.61.7.131.255	--- of phase 3	1.1.72.6.131.255
1.1.29.7.130.255	Apparent power S14 at the time of the min. daily RMS voltage of phase 1	1.1.32.3.130.255
1.1.49.7.130.255	--- of phase 2	1.1.52.3.130.255

OBIS code	Description	Capture trigger
1.1.69.7.130.255	--- of phase 3	1.1.72.3.130.255
1.1.29.7.131.255	Apparent power S14 at the time of the max. daily RMS voltage of phase 1	1.1.32.6.131.255
1.1.49.7.131.255	--- of phase 2	1.1.52.6.131.255
1.1.69.7.131.255	--- of phase 3	1.1.72.6.131.255
1.1.31.7.130.255	RMS current at the time of the min. daily RMS voltage of phase 1	1.1.32.3.130.255
1.1.51.7.130.255	--- of phase 2	1.1.52.3.130.255
1.1.71.7.130.255	--- of phase 3	1.1.72.3.130.255
1.1.31.7.131.255	RMS current at the time of the max. daily RMS voltage of phase 1	1.1.32.6.131.255
1.1.51.7.131.255	--- of phase 2	1.1.52.6.131.255
1.1.71.7.131.255	--- of phase 3	1.1.72.6.131.255

5.5 Tariff/TOU registers

The use of tariff or time-of-use (TOU) registers enable time segmentation of the total energy consumption. The available tariff/TOU registers are listed in the sections [Accumulated values](#)^[20] and [Minimum and maximum values](#)^[24].

Kamstrup OMNIA® e-meter supports the following methods for controlling tariffs/TOU registers:

1. The active tariff can be set on request.
2. Tariffs can be controlled using an activity calendar.
3. Tariffs disabled.

Note For a detailed description, see the section [Activity calendar and special days](#)^[14] or refer to the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

6 Interval loggers

Kamstrup OMNIA® e-meter maintains several interval loggers.

Each interval logger is based on the DLMS Profile Generic class for flexibility in configurations.

The interval loggers are synchronous profiles triggered on a regular basis at the end of the capture period, which is individually selectable per interval logger. The debiting 1 logger can also operate asynchronously, e.g. be triggered remotely by a head-end system.

Each interval logger has a capture object list that defines which capture objects (values or registers) are stored when the interval logger is triggered. The capture object list always has five fixed objects: Log ID, time stamp, log status, [log data quality](#)^[36] and primary energy scaler. In addition to these five, each interval logger can capture up to 24 capture objects.

Note For details about the five fixed objects, refer to the section "Profile Generic class" in the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

The primary energy scaler is selected at order time from kWh (or kvarh) with either two or three decimals.

[Secondary energy values](#)^[22] are always stored in 0.1 Wh resolution.

Changing the configuration of load profile 1, load profile 2 or debiting 1 logger triggers an entry in the [load profile change event logger](#)^[52].

In the following sections, each interval logger is described with factory settings for default capture period and default capture objects.

Note [Single-phase meters](#) do not include per-phase registers for phase 2 and 3 as default captured objects.

6.1 Load profile 1 (1.1.99.1.0.255)

Capture periods:	0, 1, 3, 5, 10, 15, 30, 60 minutes.
Default capture period:	Selected at order time.
Default captured objects:	Selected at order time.

Note When the capture period is set to 0 minutes, the interval logger is disabled and will not trigger.

The capture object list of this logger always contains - as a minimum - either average powers or energy totals corresponding to the measuring accuracy verification printed on the meter front.

Capacity at default captured objects

Capture period (examples)	5 min.	15 min.	30 min.	60 min.
Captured objects				
A14 / A23 / R12 / R34	60 days	180 days	361 days	722 days
A14 / A23 / R12 / R34 / R1 / R2 / R3 / R4	40 days	122 days	245 days	491 days

Important The WELMEC guide 11.2 defines a suitable profile capacity in days as a factor 2.5 multiplied by the duration of the billing period. If the meter is used for billing based on interval data, Kamstrup A/S recommends that the definitions of WELMEC are complied with when configuring load profile 1.

6.2 Load profile 2 (1.1.99.2.0.255)

Capture periods:	0, 1, 3, 5, 10, 15, 30, 60, 1440 minutes.
Default capture period:	15 minutes.
Default captured objects:	Active energy A14 of phase 1 (1.1.21.8.0.255)
	Active energy A14 of phase 2 (1.1.41.8.0.255)
	Active energy A14 of phase 3 (1.1.61.8.0.255)
	Active energy A23 of phase 1 (1.1.22.8.0.255)
	Active energy A23 of phase 2 (1.1.42.8.0.255)
	Active energy A23 of phase 3 (1.1.62.8.0.255)

Note When the capture period is set to 0 minutes, the interval logger is disabled and will not trigger.

When the capture period is set to 1440 minutes, the interval logger triggers at midnight local time.

Single-phase meters do not include per-phase registers for phase 2 and 3 as default captured objects.

Capacity at default captured objects

Capture period (examples)	5 min.	15 min.	30 min.	60 min.
Captured objects				
Default captured objects	22 days	67 days	134 days	268 days

6.3 Debiting 1 logger (1.1.98.1.0.255)

Capture periods:	1 month.
Default capture period:	1 month.

Default captured objects:	Active energy A14 (1.1.1.8.0.255)
	Active energy A23 (1.1.2.8.0.255)
	Reactive energy R12 (1.1.3.8.0.255)
	Reactive energy R34 (1.1.4.8.0.255)
	Active energy A14 for tariff x ($1 \leq x \leq 4$) (1.1.1.8.x.255)
	Active energy A23 for tariff x ($1 \leq x \leq 4$) (1.1.2.8.x.255)
	Max. active power P14 (1.1.1.6.0.255)

Note This logger is synchronously triggered by a single action schedule; hence the capture period attribute always returns "0".

Capacity at default captured objects

	Capture period (examples)	1 month
Captured objects		
Default captured objects		108 months

The debiting 1 logger can be triggered asynchronously on request from a head-end system by a maximum demand reset. The monthly trigger occurs at midnight local time on the 1st of the month.

6.4 Debiting 2 logger (1.1.98.2.0.255)

Capture periods:	Daily.
Default capture period:	Daily.
Default captured objects:	Active energy A14 (1.1.1.8.0.255)
	Active energy A14 for tariff 1 (1.1.1.8.1.255)
	Active energy A14 for tariff 2 (1.1.1.8.2.255)
	Active energy A23 (1.1.2.8.0.255)
	Active energy A23 for tariff 1 (1.1.2.8.1.255)
	Active energy A23 for tariff 2 (1.1.2.8.2.255)
	Reactive energy R12 (1.1.3.8.0.255)
	Reactive energy R12 for tariff 1 (1.1.3.8.1.255)
	Reactive energy R12 for tariff 2 (1.1.3.8.2.255)
	Reactive energy R34 (1.1.4.8.0.255)
	Reactive energy R34 for tariff 1 (1.1.4.8.1.255)
	Reactive energy R34 for tariff 2 (1.1.4.8.2.255)

Note This logger is synchronously triggered by a single action schedule; hence the capture period attribute always returns "0".

Capacity at default captured objects

	Capture period (examples)	Daily
Captured objects		
Default captured objects		496 days

The daily capture period triggers at midnight local time.

6.5 Analysis logger (1.1.99.1.1.255)

Capture periods:	0, 1, 3, 5, 10, 15, 30, 60 minutes.
Default capture period:	10 minutes.
Default captured objects:	Average frequency (1.1.14.25.0.255)
	Average RMS current of phase 1 (1.1.31.25.0.255)
	Average RMS current of phase 2 (1.1.51.25.0.255)
	Average RMS current of phase 3 (1.1.71.25.0.255)
	Average RMS voltage of phase 1 (1.1.32.25.0.255)
	Average RMS voltage of phase 2 (1.1.52.25.0.255)
	Average RMS voltage of phase 3 (1.1.72.25.0.255)

Note When the capture period is set to 0 minutes, the interval logger is disabled and will not trigger.

Single-phase meters do not include per-phase registers for phase 2 and 3 as default captured objects.

Capacity at default captured objects

	Capture period (examples)	5 min.	10 min.	30 min.	60 min.
Captured objects					
Default captured objects		24 days	49 days	148 days	296 days

6.6 Occurrence counter logger (1.1.99.98.17.255)

Capture periods:	Daily.
Default capture period:	Daily.
Default captured objects:	VQ_Counter_F1 (1.1.133.0.1.255) ³⁸
	VQ_Counter_F2 (1.1.133.0.2.255) ³⁸
	VQ_Counter_F3 (1.1.133.0.3.255) ³⁸
	VQ_Counter_F4 (1.1.133.0.4.255) ³⁸
	VQ_Counter_F5 (1.1.133.0.5.255) ³⁸

	VQ_Counter_F6 (1.1.133.0.6.255) ³⁸
	VQ_Counter_F7 (1.1.133.0.7.255) ³⁸
	VQ_Counter_F8 (1.1.133.0.8.255) ³⁸
	VQ_Counter_VoltageVariation_Low1 (1.1.133.0.9.255) ³⁸
	VQ_Counter_VoltageVariation_Low2 (1.1.133.0.10.255) ³⁸
	VQ_Counter_VoltageVariation_High (1.1.133.0.11.255) ³⁸
	VQ_Counter_RapidVoltageChanges (1.1.133.0.12.255) ⁴⁰
	VQ_Counter_Voltage_Unbalance (1.1.133.0.13.255) ⁴¹
	VQ_Counter_Interupts_Long (1.1.133.0.14.255) ⁴⁰
	VQ_Counter_Interupts_Short (1.1.133.0.15.255) ⁴⁰
	VQ_Counter_THD_U_L1 (1.1.133.0.16.255) ⁴¹
	VQ_Counter_THD_U_L2 (1.1.133.0.17.255) ⁴¹
	VQ_Counter_THD_U_L3 (1.1.133.0.18.255) ⁴¹
	VQ_Counter_THD_I_L1 (1.1.133.0.21.255) ⁴¹
	VQ_Counter_THD_I_L2 (1.1.133.0.22.255) ⁴¹
	VQ_Counter_THD_I_L3 (1.1.133.0.23.255) ⁴¹
	Number of voltage sags in phase L1 (1.0.32.32.0.255) ⁴³
	Number of voltage sags in phase L2 (1.0.52.32.0.255) ⁴³
	Number of voltage sags in phase L3 (1.0.72.32.0.255) ⁴³
	Number of voltage swells in phase L1 (1.0.32.36.0.255) ⁴³
	Number of voltage swells in phase L2 (1.0.52.36.0.255) ⁴³
	Number of voltage swells in phase L3 (1.0.72.36.0.255) ⁴⁴

Note The capture object list of the occurrence counter logger is not configurable.

This logger is synchronously triggered by a single action schedule; hence the capture period attribute always returns "0".

Capacity at default captured objects

	Capture period (examples)	Daily
Captured objects		
Default captured objects		60 days

The daily capture period triggers at midnight local time.

The table below lists an example readout of the occurrence counter logger with a daily capture period. With this information, it is possible to calculate the total percentage of time that conditions have been outside the limits given in EN 50160. The table shows these calculations in the column to the right. In the example, it can be seen that the THDU_L2 is above the requirements (THDU higher than 8% for more than 5% of the time in a week). The example assumes a 10-minutes window is used for average THD calculations.

Example snippet of the occurrence counter logger:

OBIS Code	Log ID (Daily)	1	2	3	4	5	6	7	No. of events in a week	Total time in a week
	RTC (example with daily capture period)	20/1 2020	21/1 2020	22/1 2020	23/1 2020	24/1 2020	25/1 2020	26/1 2020		
1.1.133.0.14.255	VQ_Counter_Interupts_Long	0	0	0	0	0	0	0	0	
1.1.133.0.15.255	VQ_Counter_Interupts_Short	0	0	0	1	2	0	0	3	
1.1.133.0.16.255	VQ_Counter_THD_U_L1	2	3	1	2	3	2	2	15	1.5 %
1.1.133.0.17.255	VQ_Counter_THD_U_L2	9	8	12	8	14	7	10	68	6.7 %
1.1.133.0.18.255	VQ_Counter_THD_U_L3	1	1	4	3	1	2	1	13	1.3 %
...	...									

6.7 GSM diagnostics logger (0.0.99.98.18.255)

The GSM diagnostics logger stores attributes from the DLMS GSM diagnostics class, relevant for analysing the operation of the cellular network.

Hint The *status* attribute indicates the network registration status of the modem, i.e. GMM attach state.

The *ps_status* attribute indicates the active access technology, i.e. GPRS, LTE cat. M or NB-IoT.

The *cell information* attribute contains cell information, i.e. information about the network and signal quality.

The *LTE_quality_of_service* attribute contains information on quality of service for LTE cat. M1 and NB-IoT, i.e. signal quality and enhanced coverage level.

Capture periods:	Triggered by single action schedule (0.153.15.0.0.255)
Default capture period:	60 minutes.
Default captured objects:	GSM diagnostic status (0.0.25.6.0.255 : 3)
	GSM diagnostic ps_status (0.0.25.6.0.255 : 5)
	GSM diagnostic cell information (0.0.25.6.0.255 : 6)
	LTE monitoring LTE_quality_of_service (0.0.25.11.0.255 : 3)

Note Besides the listed default captured objects, the GSM diagnostics logger only captures three of the five fixed objects described in [Interval loggers](#)³⁰⁾, namely Log ID, time stamp and log status.

Capacity at default captured objects

Capture period (examples)	15 min.	30 min.	60 min.
	Captured objects		
Default captured objects	2 days	4 days	8 days

6.8 Data quality attribute

The data quality attribute is included in each interval logger entry. It tells if the values of that logger entry coincide with any of the following events, which could influence how the data should be interpreted.

Event marking	Description
Clock set between 7-15 seconds	Set if the meter time is adjusted within the capture period, either by a user or autonomously during time synchronisation. The interval is fixed and cannot be changed.
Clock set between 15-60 seconds	Set if the meter time is adjusted within the capture period, either by a user or autonomously during time synchronisation. The interval is fixed and cannot be changed.
Clock set between 60-180 seconds	Set if the meter time is adjusted within the capture period, either by a user or autonomously during time synchronisation. The interval is fixed and cannot be changed
Clock set more than 180 seconds	Set if the meter time is adjusted within the capture period, either by a user or autonomously during time synchronisation. The interval is fixed and cannot be changed
Clock set forward	Set together with one of the above intervals. Identifies if the meter time is changed forward (to a later point in time). Any logger entries created by automatic filling and the first subsequent entry are marked.
Clock set backward	Set together with one of the above intervals. Identifies if the meter time is changed backward (to an earlier point in time). Any logger entries time stamped "ahead of time" are marked.
Legal parameter error	Set when a memory CRC error is detected when restoring data during start-up sequence. This flag is not cleared. All following logger entries are marked.
Overvoltage	Set when the voltage on any phase exceeds 265V. The threshold is fixed and cannot be changed. This flag is cleared when the phase voltage returns below the threshold. Any logger entries during the overvoltage are marked.
Undervoltage	Set when the voltage on any phase drops below 184V. The threshold is fixed and cannot be changed.

Event marking	Description
	<p>This flag is cleared when the phase voltage returns above the threshold. Any logger entries during the undervoltage are marked.</p>
<p>Power outage</p>	<p>Set when the meter powers up after a supply voltage interruption acting on all phases for longer than 180 seconds.</p> <p>Any logger entries created by automatic filling and the first subsequent entry are marked.</p>

7 Power quality

Kamstrup OMNIA® e-meter is equipped with a power quality assessment tool. It is based on the requirements in EN 50160 regarding power quality delivered from utilities.

The power quality assessment in Kamstrup OMNIA® e-meter is based on events, i.e. information is only registered if a parameter exceeds its limits. Power quality events are logged in the [Power quality event logger](#)^[49].

Additionally, the [Occurrence counter logger](#)^[33] captures a set of counter registers, which are incremented when the limits of EN 50160 are exceeded.

7.1 Power frequency

Kamstrup OMNIA® e-meter measures a 10-seconds mean value of the line frequency and compares this value with the limits given in EN50160. Each occurrence of this 10-seconds mean value that exceeds the limits is registered in one of the following occurrence counters.

OBIS code	Parameter	Description
1.1.133.0.1.255	VQ_Counter_F1	Incremented when $(f_n - 2\%) \leq \text{avg. frequency} < (f_n - 1\%)$.
1.1.133.0.2.255	VQ_Counter_F2	Incremented when $(f_n + 1\%) < \text{avg. frequency} \leq (f_n + 2\%)$.
1.1.133.0.3.255	VQ_Counter_F3	Incremented when $(f_n - 15\%) \leq \text{avg. frequency} < (f_n - 6\%)$.
1.1.133.0.4.255	VQ_Counter_F4	Incremented when $(f_n + 4\%) < \text{avg. frequency} \leq (f_n + 15\%)$.
1.1.133.0.5.255	VQ_Counter_F5	Incremented when $(f_n - 6\%) \leq \text{avg. frequency} < (f_n - 2\%)$.
1.1.133.0.6.255	VQ_Counter_F6	Incremented when $(f_n + 2\%) < \text{avg. frequency} \leq (f_n + 4\%)$.
1.1.133.0.7.255	VQ_Counter_F7	Incremented when $\text{avg. frequency} < (f_n - 15\%)$.
1.1.133.0.8.255	VQ_Counter_F8	Incremented when $(f_n + 15\%) < \text{avg. frequency}$.

7.2 Overvoltage and undervoltage

Kamstrup OMNIA® e-meter calculates the mean values of phase voltages in consecutive windows of selectable duration and compares each mean value with user-defined limits. If either limit is exceeded, the "undervoltage Ln" or "overvoltage Ln" event for the corresponding phase is triggered.

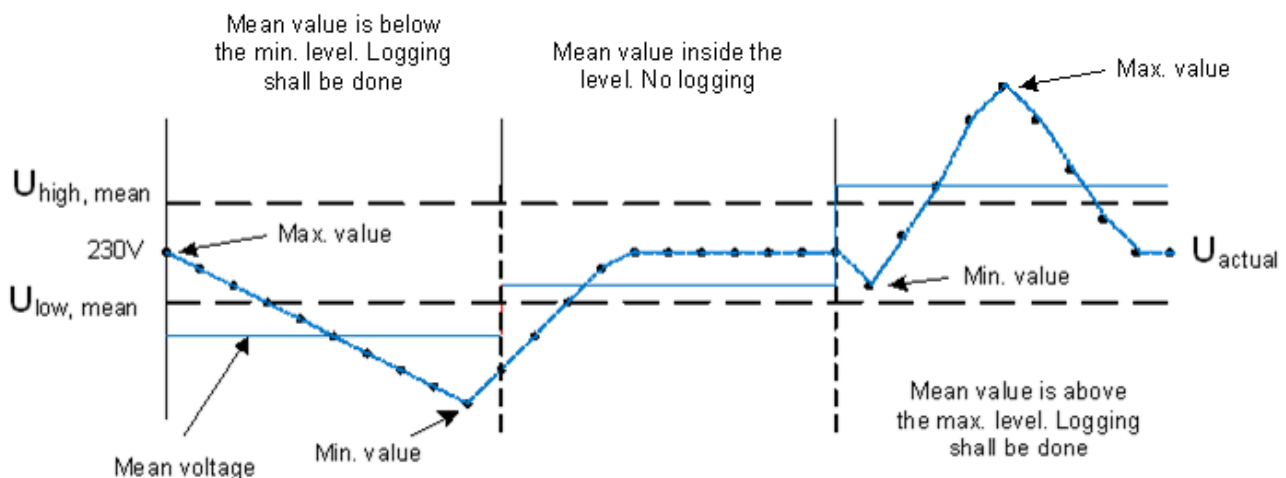


Figure 7: Examples of detection of undervoltage and overvoltage

Each occurrence of this mean value exceeding the limits is registered in an occurrence counter.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.12.35.0.255	U _{high,mean}	Limit for triggering "overvoltage Ln" event (limit in % of nominal voltage).	1%	20%	10%
1.1.12.31.0.255	U _{low,mean}	Limit for triggering "undervoltage Ln" event (limit in % of nominal voltage).	- 20%	-1%	-10%
1.1.12.44.0.255	U _{time-period,mean}	Duration of the window for mean voltage calculation (duration in seconds).	10 sec.	1800 sec.	600 sec.
1.1.133.0.9.255	VQ_Counter_VoltageVariation_Low1	Incremented when avg. voltage of any phase < (Un - 10%).			
1.1.133.0.10.255	VQ_Counter_VoltageVariation_Low2	Incremented when avg. voltage of any phase < U _{low,mean} .			
1.1.133.0.11.255	VQ_Counter_VoltageVariation_High	Incremented when avg. voltage of any phase > U _{high,mean} .			

7.3 Supply voltage interruption

Kamstrup OMNIA® e-meter detects all supply voltage interruptions.

7.3.1 Acting on a subset of connected phases

The detection limit is selectable when the supply voltage interruption occurs on a subset of connected phases, i.e. the meter is still powered. In this scenario, if the detection limit and time threshold are exceeded, the "missing voltage Ln" event for the corresponding phase(s) is triggered.

In general, "missing voltage Ln" events suppress "undervoltage Ln" events. Depending on the setting of the time threshold, it is possible to observe an "undervoltage Ln" event followed by a "missing voltage Ln" event, even if the phase voltage actually dropped instantly from Un to 0V.

Example:

The phase voltage of Ln drops to 0V halfway through the undervoltage evaluation window and the "undervoltage Ln" event is triggered. The time threshold for "missing voltage Ln" is set at 10 minutes and the positive evaluation of this event exceeds the undervoltage evaluation window. The result is an "undervoltage Ln" event followed by a "missing voltage Ln" event.

Note In desktop testing scenarios, in case a single-phase voltage is looped to all three-phase inputs of a meter, and the test sequence includes disconnecting at least one phase input, that phase input must be loaded with a load to neutral of at least 0.5 W or alternatively shorted to neutral.

7.3.2 Acting on all connected phases

When the supply voltage interruption acts on all connected phases, the detection is based on a hardware signal. In this scenario, the "power down" event is triggered.

No time threshold applies to the "power down" event and the actual event logging is done when power is restored to the meter. The time stamp of the event identifies the beginning of the all-phase supply voltage interruption.

Note In case of a supply voltage interruption acting on all connected phases, the "missing voltage Ln" events are suppressed and will not trigger.

A last gasp enabled meter can push a last gasp message to the head-end system when an all-phase supply voltage interruption occurs. For details, see [Last gasp](#)^[59].

Independent of the number of affected phases, each occurrence of supply voltage interruption is registered in one of two occurrence counters, depending on the duration of the interruption. According to EN 50160, supply voltage interruptions are divided into short interruptions (≤ 3 minutes) and long interruptions (> 3 minutes). The occurrence counters count all supply voltage interruptions and are thus not filtered by $U_{\text{outage, timethreshold}}$

OBIS code	Parameter	Description	Min.	Max.	Default
1.0.12.39.0.255	$U_{\text{outagelevel}}$	Limit for triggering "missing voltage Ln" event and for incrementing occurrence counters (limit in volts).	50 V	160 V	50 V
1.0.12.45.0.255	$U_{\text{outage, timethreshold}}$	Time threshold for triggering "missing voltage Ln" event (duration in seconds)	1 sec.	1800 sec.	10 sec.
1.1.133.0.14.255	VQ_Counter_Interupts_Long	Incremented when a supply voltage interruption longer than or equal to 3 minutes is detected on any phase. This object is not filtered by $U_{\text{outage, timethreshold}}$			
1.1.133.0.15.255	VQ_Counter_Interupts_Short	Incremented when a supply voltage interruption shorter than 3 minutes is detected on any phase. This object is not filtered by $U_{\text{outage, timethreshold}}$			

7.4 Rapid voltage change

Kamstrup OMNIA® e-meter detects a rapid voltage change when two consecutive instantaneous values of "RMS voltage of phase n" differ by 5% of U_n or more, i.e. $\Delta V \geq 11.5$ V in a 230 V system.

If the "RMS voltage of phase n" exceeds the detection limits for voltage dips or swells, the event is characterized as a voltage dip/swell rather than a rapid voltage change.

Note Instantaneous values are characterized by a refresh rate of 1 second. For further details, see the section [Instantaneous values](#)^[16].

Each occurrence of rapid voltage change is registered in the following occurrence counter.

OBIS code	Parameter	Description
1.1.133.0.12.255	VQ_Counter_RapidVoltageChanges	Incremented when a rapid voltage change is detected.

7.5 Supply voltage unbalance

Kamstrup OMNIA® e-meter calculates the mean supply voltage unbalance in consecutive windows of 10 minutes.

Supply voltage unbalance is a measure of the balance between the three phase voltages, taking both magnitude and phase shift into account. If either is unequal across the three phases, the system is said to have an unbalance. As an example, supply voltage unbalance can occur in sections of the distribution grid where one of the phases sees a significantly higher load than the two others.

Note This feature only applies to multi-phase meters and works as intended only when all three phases and neutral are connected.

The unbalance is calculated using an approximated method shown to give an error less than 3‰ in the supply voltage range $220\text{ V} \leq U \leq 240\text{ V}$.

Each occurrence of the mean supply voltage unbalance exceeding 2% (the limit defined in EN 50160) is registered in the following occurrence counter.

OBIS code	Parameter	Description
1.1.133.0.13.255	VQ_Counter_Voltage_Unbalance	Incremented when supply voltage unbalance exceeds 2%.

7.6 Total harmonic distortion

Kamstrup OMNIA® e-meter compares instantaneous values of total harmonic distortion voltage (THDU) and current (THDI) per phase to user-defined limits. If either of the detection limits and the time threshold is exceeded, the "THDU high Ln" or "THDI high Ln" event for the corresponding phase is triggered.

Note Instantaneous values are characterised by a refresh rate of 1 second. For further details, see the section [Instantaneous values](#)^[16].

For details about total harmonic distortion, see [Harmonic voltage and current distortion](#)^[20].

Additionally, the meter calculates the mean values of total harmonic distortion voltage (THDU) and current (THDI) per phase in consecutive windows of 10 minutes duration. Each occurrence of this 10-minutes mean THDU or THDI exceeding 8% (the limit defined in EN 50160) is registered in one of the following occurrence counters.

OBIS code	Parameter	Description	Min.	Max.	Default
1.0.12.31.124.255	THDU limit	Limit for triggering "THDU high Ln" event (limit in percent).	1%	15%	8%
1.0.12.44.124.255	THDU time threshold	Time threshold for triggering "THDU high Ln" and "THDU high Ln ended" events (duration in seconds).	10 sec.	1800 sec.	600 sec.

OBIS code	Parameter	Description	Min.	Max.	Default
1.0.11.31.124.255	THDI limit	Limit for triggering "THDI high Ln" event (limit in percent).	1%	15%	8%
1.0.11.44.124.255	THDI time threshold	Time threshold for triggering "THDI high Ln" and "THDI high Ln ended" events (duration in seconds).	10 sec.	1800 sec.	600 sec.
1.1.133.0.16.255	VQ_Counter_THD_U_L1	Incremented when avg. THDU of phase 1 > 8%.			
1.1.133.0.17.255	VQ_Counter_THD_U_L2	Incremented when avg. THDU of phase 2 > 8%.			
1.1.133.0.18.255	VQ_Counter_THD_U_L3	Incremented when avg. THDU of phase 3 > 8%.			
1.1.133.0.21.255	VQ_Counter_THD_I_L1	Incremented when avg. THDI of phase 1 > 8%.			
1.1.133.0.22.255	VQ_Counter_THD_I_L2	Incremented when avg. THDI of phase 2 > 8%.			
1.1.133.0.23.255	VQ_Counter_THD_I_L3	Incremented when avg. THDI of phase 3 > 8%.			

7.7 Supply voltage sags and swells

Kamstrup OMNIA® e-meter detects supply voltage sags and swells of a duration down to 20 milliseconds.

For every period of nominal frequency, the voltage on each phase is compared to the user-defined thresholds for sag and swell. If either detection limit or the time limit is exceeded, a sag or swell is recorded as illustrated below.

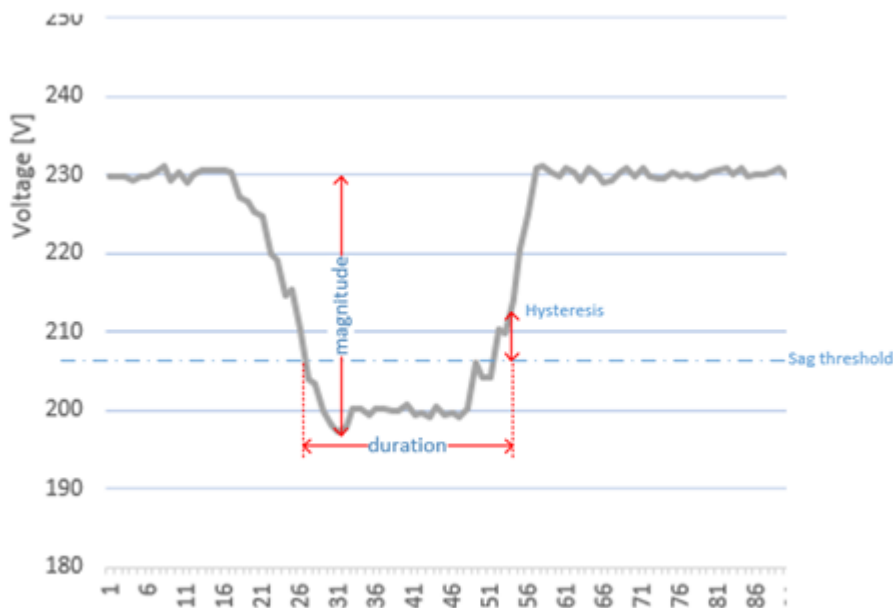


Figure 8: Example of a voltage sag showing the recorded parameters and configuration parameters

Hint A sag/swell ends when the voltage is above/below the corresponding detection limit +/- a hysteresis. The hysteresis is fixed at 2% of the nominal voltage.

A sag/swell of a longer duration than 60 seconds is not considered a sag/swell and is not recorded.

Each occurrence of a voltage sag or swell is registered in one of the following occurrence counters and the duration and magnitude of the last occurring sag or swell is available in the relevant objects listed below.

OBIS code	Parameter	Description	Min.	Max.	Default
1.0.12.31.0.255	Threshold for voltage sag	Limit for recording voltage sag (limit in 10^{-1} volts)	11.5 V	216.0 V	207.0 V
1.0.12.43.0.255	Time threshold for voltage sag	Time threshold for recording voltage sag (duration in 10^{-2} seconds).	20 millisecc.	60 sec.	20 millisecc.
1.0.12.35.0.255	Threshold for voltage swell	Limit for recording voltage swell (limit in 10^{-1} volts).	253.0 V	288.0 V	253.0 V
1.0.12.44.0.255	Time threshold for voltage swell	Time threshold for recording voltage swell (duration in 10^{-2} seconds).	20 millisecc.	60 sec.	20 millisecc.
1.0.32.32.0.255	Number of voltage sags in phase L1	Incremented when a voltage sag in phase L1 is detected.			
1.0.52.32.0.255	Number of voltage sags in phase L2	Incremented when a voltage sag in phase L2 is detected.			
1.0.72.32.0.255	Number of voltage sags in phase L3	Incremented when a voltage sag in phase L3 is detected.			
1.0.32.33.0.255	Duration of last voltage sag in phase L1	Duration of the last occurring voltage sag in phase L1 (duration in 10^{-2} seconds).			
1.0.52.33.0.255	Duration of last voltage sag in phase L2	Duration of the last occurring voltage sag in phase L2 (duration in 10^{-2} seconds).			
1.0.72.33.0.255	Duration of last voltage sag in phase L3	Duration of the last occurring voltage sag in phase L3 (duration in 10^{-2} seconds).			
1.0.32.34.0.255	Magnitude of last voltage sag in phase L1	Magnitude of the last occurring voltage sag in phase L1 (magnitude in 10^{-1} volts).			
1.0.52.34.0.255	Magnitude of last voltage sag in phase L2	Magnitude of the last occurring voltage sag in phase L2 (magnitude in 10^{-1} volts).			
1.0.72.34.0.255	Magnitude of last voltage sag in phase L3	Magnitude of the last occurring voltage sag in phase L3 (magnitude in 10^{-1} volts).			
1.0.32.36.0.255	Number of voltage swells in phase L1	Incremented when a voltage swell in phase L1 is detected.			
1.0.52.36.0.255	Number of voltage swells in phase L2	Incremented when a voltage swell in phase L2 is detected.			

OBIS code	Parameter	Description	Min.	Max.	Default
1.0.72.36.0.255	Number of voltage swells in phase L3	Incremented when a voltage swell in phase L3 is detected.			
1.0.32.37.0.255	Duration of last voltage swell in phase L1	Duration of the last occurring voltage swell in phase L1 (duration in 10^{-2} seconds).			
1.0.52.37.0.255	Duration of last voltage swell in phase L2	Duration of the last occurring voltage swell in phase L2 (duration in 10^{-2} seconds).			
1.0.72.37.0.255	Duration of last voltage swell in phase L3	Duration of the last occurring voltage swell in phase L3 (duration in 10^{-2} seconds).			
1.0.32.38.0.255	Magnitude of last voltage swell in phase L1	Magnitude of the last occurring voltage swell in phase L1 (magnitude in 10^{-1} volts).			
1.0.52.38.0.255	Magnitude of last voltage swell in phase L2	Magnitude of the last occurring voltage swell in phase L2 (magnitude in 10^{-1} volts).			
1.0.72.38.0.255	Magnitude of last voltage swell in phase L3	Magnitude of the last occurring voltage swell in phase L3 (magnitude in 10^{-1} volts).			

8 Grid events

Kamstrup OMNIA® e-meter detects events in the electric distribution grid. A grid event is characterised by (and differs from power quality monitoring in that) the root cause typically being a disconnected or broken conductor.

Grid event are logged in the [Standard event logger](#)^[46] or in the [Power quality event logger](#)^[49].

8.1 Neutral fault

Kamstrup OMNIA® e-meter detects when a neutral wire in the low voltage distribution grid is disconnected or broken by monitoring the instantaneous values of phase voltages and comparing them to user-defined limits. When at least one phase voltage exceeds the upper limit and at least one other phase voltage exceeds the lower limit, the "missing neutral" event is triggered.

Note This feature only applies to multi-phase meters and works as intended only when all three phases and neutral are connected.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.132.0.13.255	Neutral fault upper limit	Upper limit for triggering "missing neutral" event (limit in volts)	240 V	270 V	260 V
1.1.132.0.12.255	Neutral fault lower limit	Lower limit for triggering "missing neutral" event (limit in volts)	50 V	230 V	210 V
1.1.132.0.15.255	Neutral fault time threshold	Time threshold for triggering "missing neutral" and "missing neutral ended" events (duration in seconds).	1 sec.	900 sec.	60 sec.

8.2 Phase asymmetry

Kamstrup OMNIA® e-meter detects when a phase wire in the medium voltage grid is disconnected or broken by monitoring the instantaneous values of phase voltages and comparing them to user-defined limits. When exactly two phase voltages are within a range defined by an upper and a lower limit and the third phase voltage is above this range, the "phase asymmetry" event is triggered.

Note This feature only applies to multi-phase meters and works as intended only when all three phases and neutral are connected.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.132.0.11.255	Asymmetry fault upper limit	Upper limit for triggering "phase asymmetry" event (limit in volts)	50 V	230 V	170 V
1.1.132.0.10.255	Asymmetry fault lower limit	Lower limit for triggering "phase asymmetry" event (limit in volts)	50 V	230 V	90 V
1.1.132.0.16.255	Asymmetry fault time threshold	Time threshold for triggering "phase asymmetry" and "phase asymmetry ended" events (duration in seconds)	1 sec.	900 sec.	180 sec.

9 Event loggers

Kamstrup OMNIA® e-meter continuously monitors the electrical grid as well as its own state of operation. Deviations from normal, trigger an event in one of the event loggers.

Each event logger is based on the DLMS Profile Generic class and each entry is registered with a time stamp.

9.1 Standard event logger (0.0.99.98.0.255)

Kamstrup OMNIA® e-meter has a standard event logger which contains information about the meter status events. A registration in the logger can be triggered by the following events:

Event ID	Event	Description
1	Power down	A complete power down of the device.
2	Power up	The device is powered again after a complete power down.
4	Clock adjusted (old date/time)	The clock has been adjusted. The date/time that is stored in the event logger is the old date/time before adjusting the clock.
5	Clock adjusted (new date/time)	The clock has been adjusted. The date/time that is stored in the event logger is the new date/time before adjusting the clock.
6	Clock invalid	The clock may be invalid, i.e. if the power reserve of the clock has exhausted. It is set at power-up.
12	Program memory error	A physical or logical error in the program memory.
13	RAM error	A physical or logical error in the RAM.
14	NV memory error	A physical or logical error in the non-volatile memory which is either the EEPROM or the flash memory.
17	Firmware ready for activation	The firmware is ready for activation.
18	Firmware activated	The firmware has been successfully activated.
47	One or more parameters changed	A change has been made to the meter configuration, either locally or remotely.
88	Phase sequence reversal	Indicates wrong mains connection. Usually indicates fraud or wrong installation. Note For poly-phase connection only.
89	Missing neutral	Indicates that the neutral connection from the supplier to the meter is interrupted (but the neutral connection to the load prevails). The phase voltages measured by the meter may differ from their nominal values.
230	Missing neutral ended	Indicates that the neutral connection from the supplier to the meter has been restored.
222	High processor temperature	Indicates that the processor temperature has exceeded the threshold.
448	High processor temperature ended	Indicates that the processor temperature is within normal limits again.
223	Firmware downloaded	The firmware has been downloaded.
224	Firmware activating	The activation of the downloaded firmware has been started.

Event ID	Event	Description
225	No phase current	No phase current has been detected by the meter for a specific period of time.
226	Firmware activation failed	The activation of the firmware failed.
426	APS activated	The supply voltage on all connected phases is interrupted and the meter is powered from the auxiliary power supply input (APS).
427	APS input deactivated	The supply voltage has been restored and the meter is no longer powered from the auxiliary power supply (APS).
444	Current without voltage	Indicates the measurement of current on a phase without simultaneous detection of voltage. This is typically related to a hardware malfunction. The event is triggered if measured supply voltage drops below 50V RMS and the measured current is above 50mA RMS for 30 consecutive seconds.
213	Current limit L1 exceeded	Indicates that the current threshold is exceeded on phase L1.
214	Current limit L2 exceeded	Indicates that the current threshold is exceeded on phase L2.
215	Current limit L3 exceeded	Indicates that the current threshold is exceeded on phase L3.
449	Current limit L1 restored	Indicates that the current in L1 is within limits again.
450	Current limit L2 restored	Indicates that the current in L2 is within limits again.
451	Current limit L3 restored	Indicates that the current in L3 is within limits again.
452	Power factor L1 minimum limit reached	Indicates that the power factor minimum limit has been reached on phase L1.
454	Power factor L2 minimum limit reached	Indicates that the power factor minimum limit has been reached on phase L2.
456	Power factor L3 minimum limit reached	Indicates that the power factor minimum limit has been reached on phase L3.
453	Power factor L1 minimum limit cleared	Indicates that the power factor on phase L1 is within limits again.
455	Power factor L2 minimum limit cleared	Indicates that the power factor on phase L2 is within limits again.
457	Power factor L3 minimum limit cleared	Indicates that the power factor on phase L3 is within limits again.
458	Total demand limit exceeded	Indicates that the total demand threshold is exceeded.
459	Total demand limit restored	Indicates that the total demand is within limits again.
460	Demand limit L1 exceeded	Indicates that the demand threshold is exceeded on phase L1.
461	Demand limit L2 exceeded	Indicates that the demand threshold is exceeded on phase L2.
462	Demand limit L3 exceeded	Indicates that the demand threshold is exceeded on phase L3.
463	Demand limit L1 restored	Indicates that the demand in L1 is within limits again.
464	Demand limit L2 restored	Indicates that the demand in L2 is within limits again.
465	Demand limit L3 restored	Indicates that the demand in L3 is within limits again.

The standard event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

9.2 Fraud detection event logger (0.0.99.98.1.255)

Kamstrup OMNIA® e-meter has a fraud detection logger. A registration in the logger can be triggered by the following events:

Event ID	Event	Description
40	Terminal cover removed	The terminal cover has been removed.
41	Terminal cover closed	The terminal cover has been closed.
42	Strong DC field detected	A strong magnetic DC field has been detected.
43	No strong DC field anymore	A strong magnetic DC field has disappeared.
49	Decryption or authentication failure	A communication attempt with incorrect encryption keys was detected.
50	Replay attack	A communication attempt with incorrect frame counter was detected.
91	Current reversal	The current flow is reversed.
447	General signing failed	The validation of signature failed either due to wrong credentials, missing signature or malformed general signing header.

The fraud detection event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

9.3 Disconnect control event logger (0.0.99.98.2.255)

Kamstrup OMNIA® e-meter includes a logger that registers all events related to the supply control functionality. For each event (either a disconnection, a release or a reconnection), the meter logs an ID, a time stamp, the disconnect state and the connection feedback.

Event ID	Event	Description
59	Released for connection	The breaker is released for manual connection using the push button on the meter front.
60	Disconnected by push button	The breaker is manually disconnected using the push button on the meter front.
61	Connected by push button	The breaker is manually connected using the push button on the meter front.
62	Disconnected by remote command	The breaker is remotely disconnected by a system command.
63	Connected by remote command	The breaker is remotely connected by a system command.
64	Disconnected by smart disconnect	The breaker is automatically disconnected by smart disconnect.
68	Connect/Disconnect failed	An attempt to connect or disconnect has failed.
69	Connected by smart disconnect	The breaker is automatically connected by smart disconnect.

The disconnect control event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

9.4 Power quality event logger (0.0.99.98.4.255)

Kamstrup OMNIA® e-meter has a power quality event logger, which is used for registration of voltage events like overvoltage, undervoltage and supply voltage interruptions.

Event ID	Event	Description
76	Undervoltage L1	Indicates that undervoltage was detected on at least L1 phase.
77	Undervoltage L2	Indicates that undervoltage was detected on at least L2 phase.
78	Undervoltage L3	Indicates that undervoltage was detected on at least L3 phase.
406	Undervoltage L1 ended	Indicates that voltage on phase L1 is within normal limits again after undervoltage.
407	Undervoltage L2 ended	Indicates that voltage on phase L2 is within normal limits again after undervoltage.
408	Undervoltage L3 ended	Indicates that voltage on phase L3 is within normal limits again after undervoltage.
79	Overvoltage L1	Indicates that overvoltage was detected on at least L1 phase.
80	Overvoltage L2	Indicates that overvoltage was detected on at least L2 phase.
81	Overvoltage L3	Indicates that overvoltage was detected on at least L3 phase.
403	Overvoltage L1 ended	Indicates that voltage on phase L1 is within normal limits again after overvoltage.
404	Overvoltage L2 ended	Indicates that voltage on phase L2 is within normal limits again after overvoltage.
405	Overvoltage L3 ended	Indicates that voltage on phase L3 is within normal limits again after overvoltage.
82	Missing voltage L1	Indicates that the voltage on at least L1 phase has fallen below the threshold for longer than the time delay.
83	Missing voltage L2	Indicates that the voltage on at least L2 phase has fallen below the threshold for longer than the time delay
84	Missing voltage L3	Indicates that the voltage on at least L3 phase has fallen below the threshold for longer than the time delay
400	Missing voltage L1 restored	Indicates that voltage on phase L1 is within normal limits again after missing phase.
401	Missing voltage L2 restored	Indicates that voltage on phase L2 is within normal limits again after missing phase.
402	Missing voltage L3 restored	Indicates that voltage on phase L3 is within normal limits again after missing phase.
90	Phase asymmetry	Indicates phase asymmetry due to large unbalance of loads connected
428	Phase asymmetry ended	Indicates phase asymmetry conditions has ended.
431	THDU high L1	Indicates that THDU (total harmonic distortion voltage) on phase L1 has exceeded the set limit.
432	THDU high L2	Indicates that THDU (total harmonic distortion voltage) on phase L2 has exceeded the set limit.
433	THDU high L3	Indicates that THDU (total harmonic distortion voltage) on phase L3 has exceeded the set limit.
434	THDU high L1 ended	Indicates that THDU (total harmonic distortion voltage) on phase L1 is within the set limit again.

Event ID	Event	Description
435	THDU high L2 ended	Indicates that THDU (total harmonic distortion voltage) on phase L2 is within the set limit again.
436	THDU high L3 ended	Indicates that THDU (total harmonic distortion voltage) on phase L3 is within the set limit again.
437	THDI high L1	Indicates that THDI (total harmonic distortion current) on phase L1 has exceeded the set limit.
438	THDI high L2	Indicates that THDI (total harmonic distortion current) on phase L2 has exceeded the set limit.
439	THDI high L3	Indicates that THDI (total harmonic distortion current) on phase L3 has exceeded the set limit.
440	THDI high L1 ended	Indicates that THDI (total harmonic distortion current) on phase L1 is within the set limit again.
441	THDI high L2 ended	Indicates that THDI (total harmonic distortion current) on phase L2 is within the set limit again.
442	THDI high L3 ended	Indicates that THDI (total harmonic distortion current) on phase L3 is within the set limit again.

The power quality event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

For details about the detection mechanics for each power quality event, see the section [Power quality](#)³⁸.

Each power quality event has a complementary "...ended" event, which is triggered when the event condition is no longer fulfilled.

Example:

"undervoltage L1" is logged as the voltage drops below the threshold for longer than the time threshold. As the voltage exceeds the threshold for longer than the time threshold, "undervoltage L1, event inactive" is logged.

Note An "...ended" event can only be triggered following a corresponding event and only once per event.

9.5 Communication event logger (0.0.99.98.5.255)

The communication event logger registers events related to the communication module. It also contains events related to the WAN communication status.

Event ID	Event	Description
146	PDP context established	Indicates that the packet data protocol (PDP) context has been established.
147	PDP context destroyed	Indicates that the packet data protocol (PDP) context has been destroyed from the network side.
148	PDP context failure	Indicates that the meter was not able to re-establish the packet data protocol (PDP) context.
149	Modem SW reset	Indicates that the modem was restarted by a software reset.

Event ID	Event	Description
768	NTP sync success	Indicates that the NTP client has received a time response from the NTP server.
769	NTP sync failed	Indicates that there is no time response from the NTP server after a predefined number of retries.
770	HES connection established	Indicates that the head-end system (HES) communication is established.
771	HES connection destroyed	Indicates that the head-end system (HES) connection could not be established.
772	Event rate limit reached	Indicates missing communication events because the logging maximum rate has been reached.
773	Access technology changed to Cat. M1	Indicates that the modem was previously registered using another radio access technology (RAT), and is now registered to the network using Cat. M1.
774	Access technology changed to Cat. NB1	Indicates that the modem was previously registered using another radio access technology (RAT), and is now registered to the network using Cat. NB1.
775	Access technology changed to GPRS	Indicates that the modem was previously registered using another radio access technology (RAT), and is now registered to the network using GPRS.
776	Access technology changed to Cat. NB2	Indicates that the modem was previously registered using another radio access technology (RAT), and is now registered to the network using Cat. NB2.

The communication event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

9.6 Access event logger (0.0.99.98.128.255)

The access event logger registers events that relate to communication to the meter. Both remote and local attempts are detected and logged in the access event logger.

Event ID	Event	Description
26	Communication start on remote interface	The communication was started on the remote interface.
27	Communication end on remote interface	The communication has ended on the remote interface.
28	Communication started on local interface	The communication was started on the local interface.
29	Communication ended on local interface	The communication has ended on the local interface.
212	Successful reading attempt	A reading request was successfully executed.

The access event logger is a circular buffer with a capacity of 270 entries. When full, a new entry will overwrite the oldest entry.

9.7 CT ratio change event logger (1.1.99.98.9.255)

The CT ratio change event logger registers changes to the [CT ratio](#)²²⁾. Any changes to the CT ratio trigger a time stamped entry in this logger with the following values.

Hint Only Kamstrup OMNIA® e-meter CT has the CT ratio change event logger.

OBIS code	Description
0.1.96.8.0.255	Hour counter
1.1.0.4.2.1	CT ratio before change
1.1.0.4.2.255	CT ratio new
1.1.1.8.0.255	Active energy A14
1.1.1.8.0.129	Active secondary energy A14
1.1.1.8.x.255	Active energy A14 for tariff x (1≤x≤8)
1.1.2.8.0.255	Active energy A23
1.1.2.8.0.129	Active secondary energy A23
1.1.2.8.x.255	Active energy A23 for tariff x (1≤x≤8)
1.1.3.8.0.255	Reactive energy R12
1.1.3.8.0.129	Reactive secondary energy R12
1.1.3.8.x.255	Reactive energy R12 for tariff x (1≤x≤8)
1.1.4.8.0.255	Reactive energy R34
1.1.4.8.0.129	Reactive secondary energy R34
1.1.4.8.x.255	Reactive energy R34 for tariff x (1≤x≤8)
1.1.5.8.0.255	Reactive energy R1
1.1.5.8.0.129	Reactive secondary energy R1
1.1.8.8.0.255	Reactive energy R4
1.1.8.8.0.129	Reactive secondary energy R4

The CT ratio change event logger is a circular buffer with a capacity of 10 entries. When full, a new entry will overwrite the oldest entry.

9.8 Load profile change event logger (1.1.99.98.10.255)

The load profile change event logger registers changes to the configuration of load profile 1, load profile 2 and the debiting 1 logger.

Event ID	Event	Description
1	Capture object list of load profile 1 has been changed	A change has been made to the objects captured by load profile 1.
2	Load profile 1 has been cleared following a change applied to the capture object list	Load profile 1 has been cleared automatically following a change in the captured objects.
4	Load profile 1 has been cleared by command (only possible in Kamstrup factory)	Load profile 1 has been cleared by command in Kamstrup's factory.
5	Capture period of load profile 1 has been changed	A change has been made to the capture period of load profile 1.

Event ID	Event	Description
6	Load profile 1 has been disabled	Load profile 1 has been disabled.
7	Load profile 1 has been enabled	Load profile 1 has been enabled.
12	Capture object list of debiting 1 logger has been changed	A change has been made to the objects captured by debiting 1 logger.
13	Load profile 2 has been cleared	Load profile 2 has been cleared, either following a change in the captured objects or by command in Kamstrup's factory.
14	Capture period of load profile 2 has been changed	A change has been made to the capture period of load profile 2.

The load profile change event logger is a circular buffer with a capacity of 291 entries. When full, a new entry will overwrite the oldest entry.

9.9 Calculation method change event logger (0.0.99.98.131.255)

The calculation method change event logger registers changes to the [multi-phase energy aggregation method](#)^[18] (also known as the calculation method). Any changes to the calculation method trigger a time stamped entry in this logger with the following values.

Hint Only Kamstrup OMNIA® e-meter CT has the [secondary energy values](#)^[22].

OBIS code	Description
0.1.96.8.0.255	Hour counter
1.1.134.0.113.255	The calculation method before change. Can take the following values: 0: Individual import/export 1: Vector summation 2: Total summation
1.1.134.0.111.255	Calculation method new. Can take the following values: 0: Individual import/export 1: Vector summation 2: Total summation
1.1.1.8.0.255	Active energy A14
1.1.1.8.0.129	Active secondary energy A14
1.1.1.8.x.255	Active energy A14 for tariff x (1≤x≤8)
1.1.2.8.0.255	Active energy A23
1.1.2.8.0.129	Active secondary energy A23
1.1.2.8.x.255	Active energy A23 for tariff x (1≤x≤8)
1.1.3.8.0.255	Reactive energy R12
1.1.3.8.0.129	Reactive secondary energy R12
1.1.3.8.x.255	Reactive energy R12 for tariff x (1≤x≤8)
1.1.4.8.0.255	Reactive energy R34

OBIS code	Description
1.1.4.8.0.129	Reactive secondary energy R34
1.1.4.8.x.255	Reactive energy R34 for tariff x ($1 \leq x \leq 8$)
1.1.5.8.0.255	Reactive energy R1
1.1.5.8.0.129	Reactive secondary energy R1
1.1.8.8.0.255	Reactive energy R4
1.1.8.8.0.129	Reactive secondary energy R4

The calculation method change event logger is a circular buffer with a capacity of 10 entries. When full, a new entry will overwrite the oldest entry.

10 Alarms

Kamstrup OMNIA® e-meter can push alarms triggered by specific events. The alarm is pushed from the meter immediately after the event is registered in one of the event loggers.

All alarms are disabled per default and can be enabled by setting the corresponding bit in the alarm filter objects listed below. Alarm filter objects can be managed from a head-end system.

Alarms are transmitted through the communication network with priority before conventional data push.

10.1 Alarm filter 1 (0.0.97.98.10.255)

Bit	Alarm name	Trigger event
0	Clock invalid	Std 6
8	Program memory error	Std 12
9	RAM error	Std 13
10	NV memory error	Std 14

10.2 Alarm filter 2 (0.0.97.98.11.255)

Bit	Alarm name	Trigger event
0	Power down	Std 1
1	Power up	Std 2
2	Missing voltage L1	PQ 82
3	Missing voltage L2	PQ 83
4	Missing voltage L3	PQ 84
9	Phase asymmetry	PQ 90
10	Current reversal	Fraud 91
11	Phase sequence reversal	Std 88
31	Connect/disconnect failed	Disc 68

10.3 Alarm filter 3 (0.0.97.98.12.255)

Bit	Alarm name	Trigger event
0	Disconnecter ready for manual reconnection	Disc 59
1	Manual disconnection	Disc 60
2	Manual connection	Disc 61
3	Remote disconnection	Disc 62
4	Remote connection	Disc 63
5	Local disconnection	Disc 64
6	Local reconnection	Disc 69

Bit	Alarm name	Trigger event
17	Firmware activated	Std 18
18	Firmware activation failed	Std 226
19	Replay attack	Fraud 50
20	Decryption or authentication failure	Fraud 49
21	One or more parameters changed	Std 47
22	General signing failed	Fraud 447
26	Current without voltage	Std 444
27	APS activated	Std 426
28	APS input deactivated	Std 427

10.4 Alarm filter 4 (0.0.97.98.13.255)

Bit	Alarm name	Trigger event
8	Undervoltage L1	PQ 76
9	Undervoltage L2	PQ 77
10	Undervoltage L3	PQ 78
11	Overvoltage L1	PQ 79
12	Overvoltage L2	PQ 80
13	Overvoltage L3	PQ 81
14	Phase asymmetry ended	PQ 428
15	No phase current	Std 225
16	Missing neutral	Std 89
17	Missing neutral ended	Std 230
18	Strong DC field detected	Fraud 42
19	No strong DC field anymore	Fraud 43
20	Terminal cover removed	Fraud 40
21	Terminal cover closed	Fraud 41
22	Missing voltage L1 restored	PQ 400
23	Missing voltage L2 restored	PQ 401
24	Missing voltage L3 restored	PQ 402
25	Overvoltage L1 ended	PQ 403
26	Overvoltage L2 ended	PQ 404
27	Overvoltage L3 ended	PQ 405
28	Undervoltage L1 ended	PQ 406
29	Undervoltage L2 ended	PQ 407
30	Undervoltage L3 ended	PQ 408

10.5 Alarm filter 5 (0.0.97.98.14.255)

Bit	Alarm name	Trigger event
0	AccessTechM1	Com 773
1	AccessTechNB1	Com 774
2	AccessTechGPRS	Com 775
3	AccessTechNB2	Com 776
18	High processor temperature	Std 222
19	High processor temperature ended	Std 448
20	THDU high L1	PQ 431
21	THDU high L2	PQ 432
22	THDU high L3	PQ 433
23	THDU high L1 ended	PQ 434
24	THDU high L2 ended	PQ 435
25	THDU high L3 ended	PQ 436
26	THDI high L1	PQ 437
27	THDI high L2	PQ 438
28	THDI high L3	PQ 439
29	THDI high L1 ended	PQ 440
30	THDI high L2 ended	PQ 441
31	THDI high L3 ended	PQ 442

10.6 Alarm filter 6 (0.0.97.98.15.255)

Bit	Alarm name	Trigger event
0	Current limit L1 exceeded	Std 213
1	Current limit L2 exceeded	Std 214
2	Current limit L3 exceeded	Std 215
3	Current limit L1 restored	Std 449
4	Current limit L2 restored	Std 450
5	Current limit L3 restored	Std 451
6	Total demand limit exceeded	Std 458
7	Total demand limit restored	Std 459
8	Demand limit L1 exceeded	Std 460
9	Demand limit L2 exceeded	Std 461
10	Demand limit L3 exceeded	Std 462
11	Demand limit L1 restored	Std 463
12	Demand limit L2 restored	Std 464
13	Demand limit L3 restored	Std 465
14	Power factor L1 minimum limit reached	Std 452
15	Power factor L2 minimum limit reached	Std 454
16	Power factor L3 minimum limit reached	Std 456

Bit	Alarm name	Trigger event
17	Power factor L1 minimum limit cleared	Std 453
18	Power factor L2 minimum limit cleared	Std 455
19	Power factor L3 minimum limit cleared	Std 457

11 Last gasp

Kamstrup OMNIA® e-meter is available with a last gasp feature. A last gasp capable meter can push a message to the head-end system when an all-phase supply voltage interruption occurs. Last gasp is triggered by the same hardware signal informing the processor to initiate a shutdown when a supply voltage interruption occurs acting on all connected phases. The last gasp message is pushed immediately after detection.

The last gasp message payload contains a time stamp of the beginning of the all-phase supply voltage interruption.

Note For details on the last gasp message, see the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

The last gasp feature is disabled by default when the meter leaves Kamstrup's factory and can be enabled from the head-end system on relevant meters.

Important Not all meters are last gasp capable. The feature requires additional energy storage in the meter, which must be selected at order time.

12 Grid snapshot (0.0.99.98.130.255)

Kamstrup OMNIA® e-meter can push a snapshot of instantaneous values when triggered.

Grid snapshot is based on the DLMS Profile Generic class and modeled as an event logger. It has a capture object list that defines which capture objects (values or registers) are stored when a trigger occurs. Grid snapshot can capture up to 24 capture objects. The captured objects can be selected using the captured objects attribute. The default list is given in the table below.

Grid snapshot operates asynchronously, i.e. it is triggered by an event. When a trigger event occurs, a snapshot is taken of the captured objects. Any new snapshots are pushed to the head-end system according to the push setup. Grid snapshot has a circular buffer with a capacity of at least 100 snapshots.

The list of trigger events is selectable from any event in the meter using Grid snapshot event filters. All snapshots contain a Log ID, Log status, time stamp and an event ID identifying which event triggered the snapshot.

OBIS code	Description
1.1.134.0.120.255	Grid snapshot event filter 1
1.1.134.0.121.255	Grid snapshot event filter 2
1.1.134.0.122.255	Grid snapshot event filter 3
1.1.134.0.123.255	Grid snapshot event filter 4
1.1.134.0.124.255	Grid snapshot event filter 5
1.1.134.0.125.255	Grid snapshot event filter 6

Note The Grid snapshot event filters are identical in mapping to the alarm filters. See the section [Alarms](#) ⁵⁵ for mapping of Grid snapshot event filters, i.e. how to enable an event as a trigger event.

Snapshots are transmitted through the communication network with priority after conventional data push.

The default captured objects and trigger events are listed in the table below:

Default trigger events:	Overvoltage L1
	Overvoltage L2
	Overvoltage L3
	Missing voltage L1
	Missing voltage L2
	Missing voltage L3
Default captured objects:	RMS current of phase 1 (1.1.31.7.0.255)
	RMS current of phase 2 (1.1.51.7.0.255)
	RMS current of phase 3 (1.1.71.7.0.255)
	RMS voltage of phase 1 (1.1.32.7.0.255)
	RMS voltage of phase 2 (1.1.52.7.0.255)

	RMS voltage of phase 3 (1.1.72.7.0.255)
	Active power P14 (1.1.1.7.0.255)
	Active power P23 (1.1.2.7.0.255)
	Frequency (1.1.14.7.0.255)

13 Communication with head-end system

13.1 Push setups

The general read out of conventional meter data, consisting of both interval loggers and event loggers, is based on a reliable push schedule from the meter to the head-end system. It means that the meter is responsible for pushing all conventional data at regular intervals, which is handled by push setups.

Push setups are based on the DLMS Push Setup class.

A push setup operates synchronously and is triggered on a regular basis defined by the push interval. The push interval is selectable and intervals up to 24 hours are valid. The minimum push interval is 5 minutes. Default push intervals are listed in the table below.

Each push setup has a push object list that defines which objects (values or registers) are pushed when the push setup is triggered. The push object list is individually selectable per push setup.

Each push setup has a randomization window to prevent all meters from pushing data sets at the same time, e.g. at midnight.

Examples:

A meter with a push setup configured for daily push interval and 2 hours randomization window will trigger (will push data) at a randomized time between 00:00 and 02:00.

A meter with a push setup configured for 15 minutes push interval and 15 minutes randomization window will trigger (will push data) at a randomized time between hh:00 and hh:15, and again between hh:15 and hh:30 and so on, but always with 15 minutes interval between each trigger.

A meter with a push setup configured for 8 hours push interval, 6 hours randomization window and 2 hours offset will trigger (will push data) at a randomized time between 02:00 and 08:00, and again between 10:00 and 16:00, and again between 18:00 and 00:00, but always with 8 hours interval between each trigger.

The default settings for push setups are listed below.

Push setup	Default pushed objects	Default push interval	Default randomization window	Offset
0.128.25.9.0.255	Meter registration message	Daily	18 hours	4 hours
Interval loggers				
0.129.25.9.0.255	All objects in Load profile 1 (1.1.99.1.0.255)	2 hrs.	2 hrs.	-
0.162.25.9.0.255	All objects in Load profile 2 (1.1.99.2.0.255)	4 hrs.	4 hrs.	-
0.134.25.9.0.255	All objects in Debiting 1 logger (1.1.98.1.0.255)	Daily	2 hours	-
0.132.25.9.0.255	All objects in Debiting 2 logger (1.1.98.2.0.255)	Daily	2 hours	-
0.131.25.9.0.255	All objects in Analysis logger (1.1.99.1.1.255)	4 hours	4 hours	-

Push setup	Default pushed objects	Default push interval	Default randomization window	Offset
0.133.25.9.0.255	All objects in Occurrence counter logger (1.1.99.98.17.255)	Daily	6 hours	2 hours
0.153.25.9.0.255	All objects in GSM diagnostics logger (0.0.99.98.18.255)	8 hours	6 hours	2 hours
Event loggers				
0.151.25.9.0.255	All objects in Standard event logger (0.0.99.98.0.255)	Daily	6 hours	-
0.152.25.9.0.255	All objects in Fraud detection event logger (0.0.99.98.1.255)	Daily	6 hours	-
0.156.25.9.0.255	All objects in Disconnect control event logger (0.0.99.98.2.255)	Daily	6 hours	-
0.159.25.9.0.255	All objects in Power quality event logger (0.0.99.98.4.255)	Daily	6 hours	-
0.158.25.9.0.255	All objects in Communication event logger (0.0.99.98.5.255)	Daily	18 hours	4 hours
0.160.25.9.0.255	All objects in Grid snapshot (0.0.99.98.130.255)	Default not pushed	-	-

Note All objects of interval loggers are pushed per default with the exception of the primary energy scaler attribute.

For details about configuration of push setups, see the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

In case the connection between meter and head-end system is interrupted, the meter is responsible for storing the push data in a "queuing" system, waiting for network connection to be reestablished. When the network connection is restored, the meter ensures "catch-up" by pushing data in "queue" until acknowledgement is received from the head-end system.

13.2 On-demand requests

In addition to data push, it is possible to read data from the meters using on-demand requests from the head-end system. This provides the possibility to access data asynchronously or to access data not included in a push setup.

13.3 Selection of access technology

Kamstrup OMNIA® e-meter is available with several cellular access technologies. The meter can autonomously select the best suited.

When ordering a meter with multiple access technologies, the priorities of these must be selected. If the meter is unable to register to the cellular network using the primary access technology, it changes to the secondary instead. The meter has differentiated timeouts depending on the selected primary access technology.

- If the primary access technology is LTE Cat. M1, the meter changes to the secondary access technology after 5 minutes (default).
- If the primary access technology is NB-IoT, the meter changes to the secondary access technology after 20 minutes (default).

If connected using the secondary access technology, the meter will retry the primary access technology with exponentially increasing intervals starting at a default of 24 hours and with a maximum interval of 8 days.

It is possible to order the meter limited to just a single access technology. In that case, the meter will only connect using that technology.

14 Firmware upgrade

The complete firmware in the meter is divided into the following four sub-images.

- **Legal meter firmware:** This includes all features related to legal energy measurement, data handling and specific meter features. The firmware number and firmware revision are shown in the meter display during the power-up sequence.
- **Communication firmware:** This handles all communication related tasks using the integrated cellular module in the meter.
- **Bootloader firmware:** This is used for firmware image validation and upgrade. The meter has two bootloader slots for robustness to power failures during firmware upgrade. The firmware number and revision of the bootloader is shown in the meter display during the start-up sequence.
- **Setup loader firmware:** The setup loader selects the active bootloader slot during start-up and provides a secure boot swap functionality when the bootloader is replaced.

It is possible to upgrade new legal meter firmware, communication firmware and bootloader firmware remotely. This functionality is compliant to the guidelines of the WELMEC Software guide 7.2 and is approved in accordance with the MID type approval of the meter.

Any firmware upgrade session is recorded in the standard event logger and in one of three audit loggers.

14.1 Audit loggers

Kamstrup OMNIA® e-meter has three audit loggers for successful, failed and legally non-relevant firmware upgrade activity.

Besides the fixed attributes Log ID, time stamp and log status, all three audit loggers capture the same information as listed below.

Object	Description
SoftwareUploadInformationPart (1.1.96.54.2.255)	Which firmware component was target of the firmware upgrade job. Can take the following values: 0: Nothing 1: Boot loader 2: Legal application 3: Setup loader 5: Legally non-relevant application
Upload_SoftwareVariantRevision_old (1.1.96.54.3.255)	The revision of the firmware component being replaced.
Upload_SoftwareVariantRevision_new (1.1.96.54.11.255)	The revision of the new firmware component.
Upload_StartUploadInterface (1.1.96.54.6.255)	From which interface was the firmware upgrade job initiated. Can take the following values: 0: WAN interface 1: IR interface

Object	Description
OriginatorID (1.1.96.54.4.255)	The originator ID received in a firmware activate command.
Upload_SoftwareVariantNumber_old (1.1.96.54.12.255)	The software number of the firmware component being replaced.
Upload_SoftwareVariantNumber_new (1.1.96.54.13.255)	The software number of the new firmware component.
Upload_Result (1.1.96.54.14.255)	The result of the firmware upgrade job. Can take the following values: 0: Success 1: Update not completed 2: Invalid request CRC 3: Invalid image header 4: Invalid image header CRC 5: Invalid image external CRC 6: Invalid image internal CRC 7: Invalid image type 8: Invalid image memory map 9: Invalid image sequence 10: Invalid compatibility 11: Invalid image signature 12: Erase internal image failed 13: Vector table programming failed 14: Vector table verification failed 15: Copy image from external to internal memory failed 16: Invalid result CRC

14.1.1 Audit logger success (1.1.99.98.13.255)

A firmware upgrade job triggers an entry in this logger when the result is successful and the target firmware component is legally relevant, e.g. legal application, bootloader or setup loader.

The logger capacity is 100 entries and the logger is not circular in order to hold the full trace of successful upgrade jobs.

14.1.2 Audit logger fail (1.1.99.98.14.255)

A firmware upgrade job triggers an entry in this logger when the result is not successful and the target firmware component is legally relevant, e.g. legal application, bootloader or setup loader.

The logger is a circular buffer with a capacity of 100 entries. When full, a new entry will overwrite the oldest entry.

14.1.3 Audit logger non-legal (1.1.99.98.18.255)

A firmware upgrade job triggers an entry in this logger when the target firmware component is not legally relevant, independent of job success.

The logger is a circular buffer with a capacity of 25 entries. When full, a new entry will overwrite the oldest entry.

15 Data security

Kamstrup OMNIA® e-meter is protected by encryption on all communication interfaces. The security architecture is built around role-based access with each role having a separate level of privilege. The encryption method is AES-GCM 128 and it is implemented according to DLMS/COSEM security suite 0.

Note Due to the typical use cases and processes of distribution system operators (DSOs), the home area network (HAN) interface is unencrypted.

For details about the security suite, see the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

The encryption covers readout of all consumption/production data, read and write possibilities of configuration parameters and control commands like disconnect/reconnect of the internal supply control switch.

15.1 Digital signature of supply control switch commands

Kamstrup OMNIA® e-meter can be ordered with an option for digital signature support for supply control switch (SCS) state change commands. The head-end system (HES) then needs to digitally sign all SCS state change commands using its HES signing certificate in addition to encrypt the commands using the meter specific symmetric keys. This adds an additional layer of protection to these commands.

If the meter cannot verify the digital signature, the [General signing failed](#)⁴⁸⁾ event is triggered in the [Fraud detection event logger](#)⁴⁸⁾.

16 Communication interfaces

16.1 Cellular interface

Kamstrup OMNIA® e-meter is available with an integrated cellular communication interface acting as the primary communication interface towards a head-end system.

Note The characteristics of the cellular interface and supported technologies are described in the data sheet "Kamstrup OMNIA® e-meter" (doc. 5811-6542).

16.2 Optical interface

An optical interface is available on the meter front for local communication with the meter, e.g. using a field tool. The optical interface conforms to the physical properties defined in IEC/EN 62056-21.

16.3 Home area network (HAN)

Kamstrup OMNIA® e-meter is available with a home area network (HAN) interface accessible on the meter front.

16.3.1 Physical interface (HAN)

The HAN interface connector type is RJ12 and the meter holds a female connector; the external device connects via standard RJ12 male plug.

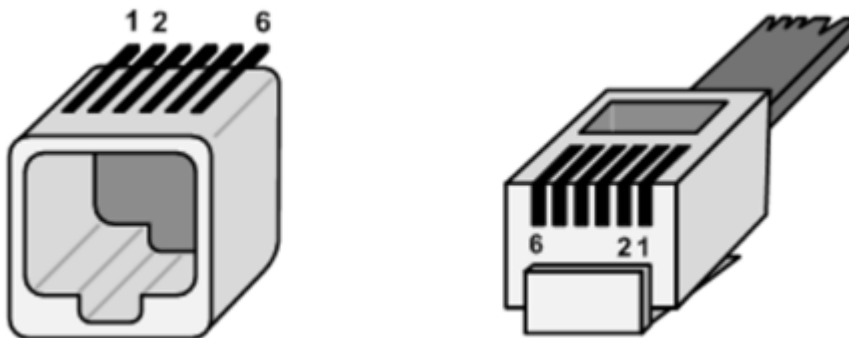


Figure 9: Physical connectors pin-out

The HAN interface pin assignment is detailed in the table below:

Pin #	Signal name	Description	Remark
1	+5V	+5V power supply	Power supply line
2	Data request	Data request	Input
3	Data GND	Data ground	
4	n.c.	Not connected	
5	Data	Data line	Output. Open collector
6	Power GND	Power ground	Power supply line

This physical interface conforms to the properties defined in DSMR v. 5.0.2 P1 companion standard, with the following exception: The HAN interface fulfills the electrical requirements of overvoltage category III, which is the level generally applicable to electricity smart meters.

Note The meter is available in a version without the +5V power supply output to the external device. This is selected at ordering.

16.3.2 "Data" line specification

The "Data" line is an Open Collector output.

The "Data" line is logically inverted.

The voltage range for LOW level for "Data" line must be between 0 VDC and 1.0 VDC.

16.3.3 "Data Request" line specification

The HAN interface is activated (starts sending data) by setting "Data Request" line high (to +5 VDC). While receiving data, the requesting external device must keep the "Data Request" line activated (set to +5 VDC).

To stop receiving data, the external device needs to drop "Data Request" line (set it to "high impedance" mode). In such case, data transfer will stop immediately.

The voltage range for HIGH level for "Data Request" line must be between 4.0 VDC and 5.5 VDC.

16.3.4 Protocol description (HAN)

The HAN interface protocol is based on the current IEC standard for local data exchange with electricity meters, IEC 62056-21 Mode D. The data is represented in ASCII format for easy interpretation in the receiving device and the transfer rate (Baud rate) is 115200 Baud.

Due to the typical use cases and processes of electricity distribution system operators (DSOs), the HAN interface is unencrypted.

16.3.5 Data telegram (HAN)

The push interval is selectable from 1 to 10 seconds through the capture period attribute of object 0.0.21.0.0.255. The HAN data telegram is disabled per default, i.e. the capture period object is set to 0 seconds.

The default push list contains the data objects below.

Hint The default push list content meets the recommendations of the Swedish industry "Branschrekommendation för lokalt kundgränssnitt för elmätare v 2.0".

OBIS code	Description
0-0:1.0.0	Date and time
1-0:1.8.0	Active energy A14
1-0:2.8.0	Active energy A23
1-0:3.8.0	Reactive energy R12
1-0:4.8.0	Reactive energy R34

OBIS code	Description
1-0:1.7.0	Active power P14
1-0:2.7.0	Active power P23
1-0:3.7.0	Reactive power Q12
1-0:4.7.0	Reactive power Q34
1-0:21.7.0	Active power P14 of phase 1
1-0:41.7.0	--- of phase 2
1-0:61.7.0	--- of phase 3
1-0:22.7.0	Active power P23 of phase 1
1-0:42.7.0	--- of phase 2
1-0:62.7.0	--- of phase 3
1-0:23.7.0	Reactive power Q12 of phase 1
1-0:43.7.0	--- of phase 2
1-0:63.7.0	--- of phase 3
1-0:24.7.0	Reactive power Q34 of phase 1
1-0:44.7.0	--- of phase 2
1-0:64.7.0	--- of phase 3
1-0:32.7.0	RMS voltage of phase 1
1-0:52.7.0	--- of phase 2
1-0:72.7.0	--- of phase 3
1-0:31.7.0	RMS current of phase 1
1-0:51.7.0	--- of phase 2
1-0:71.7.0	--- of phase 3

16.4 Hot swap extension interface

Kamstrup OMNIA® e-meter is available with a hot swap extension interface accessible under the terminal cover. The hot swap interface is a hot pluggable module interface for retrofitting modules extending or replacing functionality in the meter.

A hot swap module is fixed to the inside of a terminal cover, and the connection between the meter and the module is made by attaching the terminal cover to the meter.

Important The interface is placed on a hazardous live voltage potential (HLV). Never touch or measure the interface without appropriate measures.

Note Not all meters are equipped with the hot swap interface. The feature requires additional circuitry in the meter, which must be selected at order time.

16.4.1 Compatible modules

Kamstrup does not yet offer any modules compatible with the hot swap interface in Kamstrup OMNIA® e-meter.

An integrators guide to the hot swap interface will be released in the near future.

17 Auxiliary power supply (APS) input

Kamstrup OMNIA® e-meter is available with an auxiliary power supply (APS) input connector for bypassing external circuit switches. When connected, the meter will remain powered when an external circuit switch, located upstream in relation to the meter, is disconnected.

The APS connector accepts only a single line of AC voltage at U_n . It is a precondition that the neutral line remains connected to the meter terminals and is not disconnected by the external supply switch.

Note APS is available only in Kamstrup OMNIA® e-meter three-phase.

For details on wiring to the APS connector, see the installation guide "Installing Kamstrup OMNIA® e-meter " (doc. 5512-2370).

When all phase voltages are missing for longer than 10 seconds and the meter remains powered from the APS connector, it is said to operate in APS mode. In APS mode the meter assumes that an external upstream circuit switch has been disconnected, but the electrical grid is operating normally. Hence, any power quality related events associated with the missing phase voltages are suppressed, such as "missing voltage Ln" events or "last gasp".

When operating in APS mode, the meter continues to push data and it is possible to request data from the meter or upgrade the firmware. It is not possible to operate the supply control switch in APS mode.

Note When operating in APS mode, the [error symbol](#)¹¹⁾ in the meter display is turned on.

18 Supply control switch

Kamstrup OMNIA® e-meter variants for direct connection are available with an internal supply control switch for disconnecting and reconnecting the consumer's supply.

The supply control switch is bistable, i.e. it maintains its state (connected/disconnected) during a power outage.

Important The supply control switch must not be used for safety disconnection, i.e. disconnecting the electrical installation in relation to maintenance work or similar.

18.1 Remote on-demand disconnect

The internal supply control switch can be operated (disconnect, release and reconnect) remotely from a head-end system. Operating the supply control switch remotely requires authentication of the operator using an encryption key with the correct level of privilege.

The control mode is selectable and can be manual or automatic.

- **In manual control mode** (default), a head-end system can release the supply control switch for manual reconnection using the meter push button.
- **In automatic control mode**, a head-end system can reconnect the supply control switch with no manual interaction.

The red LED blinks when the supply control switch is released by the head-end system. To reconnect, press and hold the control push button (the right-most of the two push buttons) for 3 seconds.

Note For a description of digital signature on supply control switch commands from the head-end system, see [Digital signature of supply control switch commands](#)⁶⁷.

18.2 Manual disconnect

The internal supply control switch can be operated manually using the control push button (the right-most of the two push buttons).

To operate, press and hold the control push button (the right-most of the two push buttons) for 3 seconds.

Note The manual disconnect functionality can be disabled at order time or from a head-end system, but it is always possible to reconnect the supply control switch when it is released by the head-end system.

When disconnected manually, the internal supply control switch can be reconnected using the control push button, independent of the selected control mode (manual or automatic).

18.3 Overvoltage disconnect

The internal supply control switch can be set to disconnect automatically when the phase voltage of any phase exceeds a limit. The meter calculates the mean values of phase voltages in consecutive windows of selectable duration and compares each mean value with the user-defined limit. If the limit is exceeded, the supply control switch is disconnected.

Similarly, when all phase voltages return below a different user-defined limit, the supply control switch is reconnected. The disconnect and reconnect controls have independent and selectable window durations.

Note The overvoltage disconnect control is disabled by default and must be enabled, e.g. from a head-end system.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.128.0.19.255	Overvoltage disconnect threshold	Limit for triggering automatic overvoltage disconnect (limit in volts).	260 V	320 V	285 V
1.1.128.0.20.255	Overvoltage sample time for disconnect	Duration of the window for mean voltage calculation for automatic overvoltage disconnect (duration in seconds).	1 sec.	3600 sec.	1 sec.
1.1.128.0.21.255	Overvoltage reconnect threshold	Limit for triggering automatic reconnect following an overvoltage disconnect (limit in volts).	250 V	270 V	265 V
1.1.128.0.22.255	Overvoltage sample time for reconnect	Duration of the window for mean voltage calculation for automatic reconnect following an overvoltage disconnect (duration in seconds).	1 sec.	3600 sec.	60 sec.

19 Load control switch

Kamstrup OMNIA® e-meter is available with one or two integrated load control switches for managing (on/off) external electrical loads. Each load control relay can be individually controlled.

Note The characteristics of the load control relay are described in the data sheet "Kamstrup OMNIA® e-meter" (doc 5811-6542).

Load control relays can be operated in several modes selected by the corresponding mode selector object. One relay can operate in one mode while the other operates in a different mode.

Note For details about how to configure load control modes, see the technical guide "Kamstrup electricity meter DLMS interface specification" (doc. 5512-2571).

The load control switches may change state during a supply voltage interruption, but will return to the correct state when power is restored to the meter.

19.1 On-demand mode

The load control relay is operated on-demand from a head-end system.

In this mode, no random delay applies to the relay operation.

19.2 Activity calendar mode

The load control relay is operated by the associated activity calendar. Each relay has its own activity calendar.

Note For a detailed description of activity calendars, see the section [Activity calendar and special days](#)¹⁴.

In this mode, a random delay applies when the relay changes state to connected. The purpose of this is to distribute in time the load change seen by the electrical grid when a number of meters operate relays simultaneously. The limits of the random delay is selectable.

19.3 Active tariff mode

The load control relay operates synchronous with tariff/TOU changes.

Example:

Relay 1 operates in active tariff mode and is configured to switch off when T1 is the active tariff and switch on when T2 is the active tariff.

Note For a detailed description of tariffs/TOU, see the section [Tariff/TOU registers](#)²⁹.

In this mode, a random delay applies when the relay changes state to connected. The purpose of this is to distribute in time the load change seen by the electrical grid when a number of meters operate relays simultaneously. The limits of the random delay is selectable.

20 Unconnected phase detection

The multi-phase variant of Kamstrup OMNIA® e-meter is designed for use in 1x, 2x or 3x phase installations. The meter automatically detects which phase inputs are connected and which are not, and uses this information to suppress false positive events of Undervoltage Ln or Missing phase Ln. The phase voltage of an unconnected phase will read 0V.

The detection executes during the first start-up sequence of the meter and is updated each time the terminal cover is re-attached. Additionally, the detection continuously monitors if any phase input, initially identified as unconnected, is suddenly connected (not the other way around) even without the terminal cover being removed.

Detection during the first start-up sequence is triggered when the terminal cover is attached. Alternatively, if the terminal cover is not attached (or was never removed) within 15 minutes from the meter is energized, the detection is triggered by a timer. This time-out trigger only applies during the first start-up sequence.

The first start-up sequence is identified by an internal flag and cannot be reset when the meter has left the assembly line in Kamstrup's factory. Until detection has executed for the first time, all phases are assumed to be connected. However, phase related events can only trigger when the first detection has completed.

Hint There are three triggers to detect unconnected phases:

- (1) timed trigger during first start-up sequence
- (2) when terminal cover is re-attached
- (3) continuous monitoring of inactive phases turning active (only one-way state change allowed).

Note Supply voltage interruptions do not cause the detection to update.

In desktop testing scenarios, in case only a single-phase voltage is looped to one or several phase inputs of the meter, any unconnected phases should be loaded with at least 0.5 watt or connected to neutral to prevent unintentional floating voltage levels.

It is possible to query a meter for which phases are detected and categorized as unconnected. The unconnected phases register (1.1.134.0.112.255) represents each phase with one bit; a value of '0' means connected and '1' means unconnected.

Bit position in object 1.1.134.0.112.255	Interpretation of bit value
Bit 0 (LSB)	0: phase 1 is connected 1: phase 1 is unconnected
Bit 1	0: phase 2 is connected 1: phase 2 is unconnected
Bit 2	0: phase 3 is connected 1: phase 3 is unconnected

21 Temperature supervision

Kamstrup OMNIA® e-meter continuously monitors the temperature internally in the meter processor. The internal temperature is affected by conditions such as power conducted through the meter terminals, power sourced to an external device and the ambient temperature. A too high internal temperature can be an indicator of unintended use of the meter, such as too high current or insufficient tightening of terminals, or it could be a malfunction internally in the meter.

The temperature is measured internally in the main processor of the meter and compared to a user-defined limit.

If the detection limit and time threshold are exceeded, the "High processor temperature" event is triggered.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.137.35.0.255	ProcessorTemperatureHighThreshold	Limit for triggering "high processor temperature" event (limit in °C).	0 °C	100 °C	85 °C
1.1.137.44.0.255	ProcessorTemperatureHighTimeThreshold	Time threshold for triggering "high processor temperature" event (duration in seconds)	0 sec.	65.535 sec.	600 sec.

22 Demand supervision

Kamstrup OMNIA® e-meter continuously monitors the demand (or load) at the metering point. Each of the monitored values are compared to user-defined limits and trigger an event when that limit is exceeded.

It is possible to enable alarms for each of the demand supervision events.

22.1 Current supervision

Instantaneous values of RMS current per phase are continuously compared to a user-defined limit.

If the detection limit and time threshold are exceeded, the "Current limit Ln exceeded" event for the corresponding phase is triggered.

When the measured RMS current falls below the threshold again for longer than the time threshold, the "Current limit Ln restored" event for the corresponding phase is triggered.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.11.35.0.255 (in direct meter)	CurrentMaxThreshold	Limit for triggering "current limit Ln exceeded" event (limit in ampere).	0 A	100 A	100 A
1.1.11.35.0.255 (in CT meter)	CurrentMaxThresholdCT	Limit for triggering "current limit Ln exceeded" event (limit in ampere).	0 A	6000 A	6000 A
1.1.11.44.0.255	CurrentMaxTimeThreshold	Time threshold for triggering "current limit Ln exceeded" event (duration in seconds)	0 sec.	65.535 sec.	600 sec.

22.2 Power supervision

Instantaneous values of imported active power (P14), total and per phase, are continuously compared to user-defined limits.

If the detection limit and time threshold are exceeded, the "Total demand limit exceeded" event or the "Demand limit Ln exceeded" event for the corresponding phase is triggered.

When the measured active power falls below the threshold again for longer than the time threshold, the "Total demand limit restored" event or the "Demand limit Ln restored" event for the corresponding phase is triggered.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.1.35.0.255 (in direct meter)	TotalDemandLimitThreshold	Limit for triggering "total demand limit exceeded" event (limit in watts).	0 W	72 kW	72 kW
1.1.1.35.0.255 (in CT meter)	TotalDemandLimitThresholdCT	Limit for triggering "total demand limit exceeded" event (limit in watts).	0 W	4.3 MW	4.3 MW
1.1.1.44.0.255	TotalDemandLimitTimeThreshold	Time threshold for triggering "total demand limit exceeded" event (duration in seconds)	0 sec.	65.535 sec.	600 sec.

OBIS code	Parameter	Description	Min.	Max.	Default
1.2.1.35.0.255 (in direct meter)	DemandLimitThreshold	Limit for triggering "demand limit Ln exceeded" event (limit in watts).	0 W	24 kW	24 kW
1.2.1.35.0.255 (in CT meter)	DemandLimitThresholdCT	Limit for triggering "demand limit Ln exceeded" event (limit in watts).	0 W	1.4 MW	1.4 MW
1.2.1.44.0.255	DemandLimitTimeThreshold	Time threshold for triggering "demand limit Ln exceeded" event (duration in seconds)	0 sec.	65.535 sec.	600 sec.

22.3 Power factor supervision

Instantaneous values of power factor per phase are continuously compared to a user-defined limit.

If the detection limit and time threshold are exceeded, the "Power factor Ln minimum limit reached" event for the corresponding phase is triggered.

When the power factor rise above the threshold again for longer than the time threshold, the "Power factor Ln minimum limit cleared" event for the corresponding phase is triggered.

OBIS code	Parameter	Description	Min.	Max.	Default
1.1.13.31.0.255	PowerFactorThreshold	Limit for triggering "power factor Ln minimum limit reached" event (arbitrary unit).	0	0.9	0.1
1.1.13.43.0.255	PowerFactorTimeThreshold	Time threshold for triggering "power factor Ln minimum limit reached" event (duration in seconds)	0 sec.	65.535 sec.	600 sec.

23 Disposal of worn out meters

Kamstrup offers to handle disposal of worn out products when contractually agreed. When worn out meters are scrapped by Kamstrup, approximately 80 % of their weight is being recycled.

Any scrapping of worn out meters, handled by Kamstrup or by any other party, must be completed in accordance with local regulations.

Worn out products must not be disposed of as regular waste.